




PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

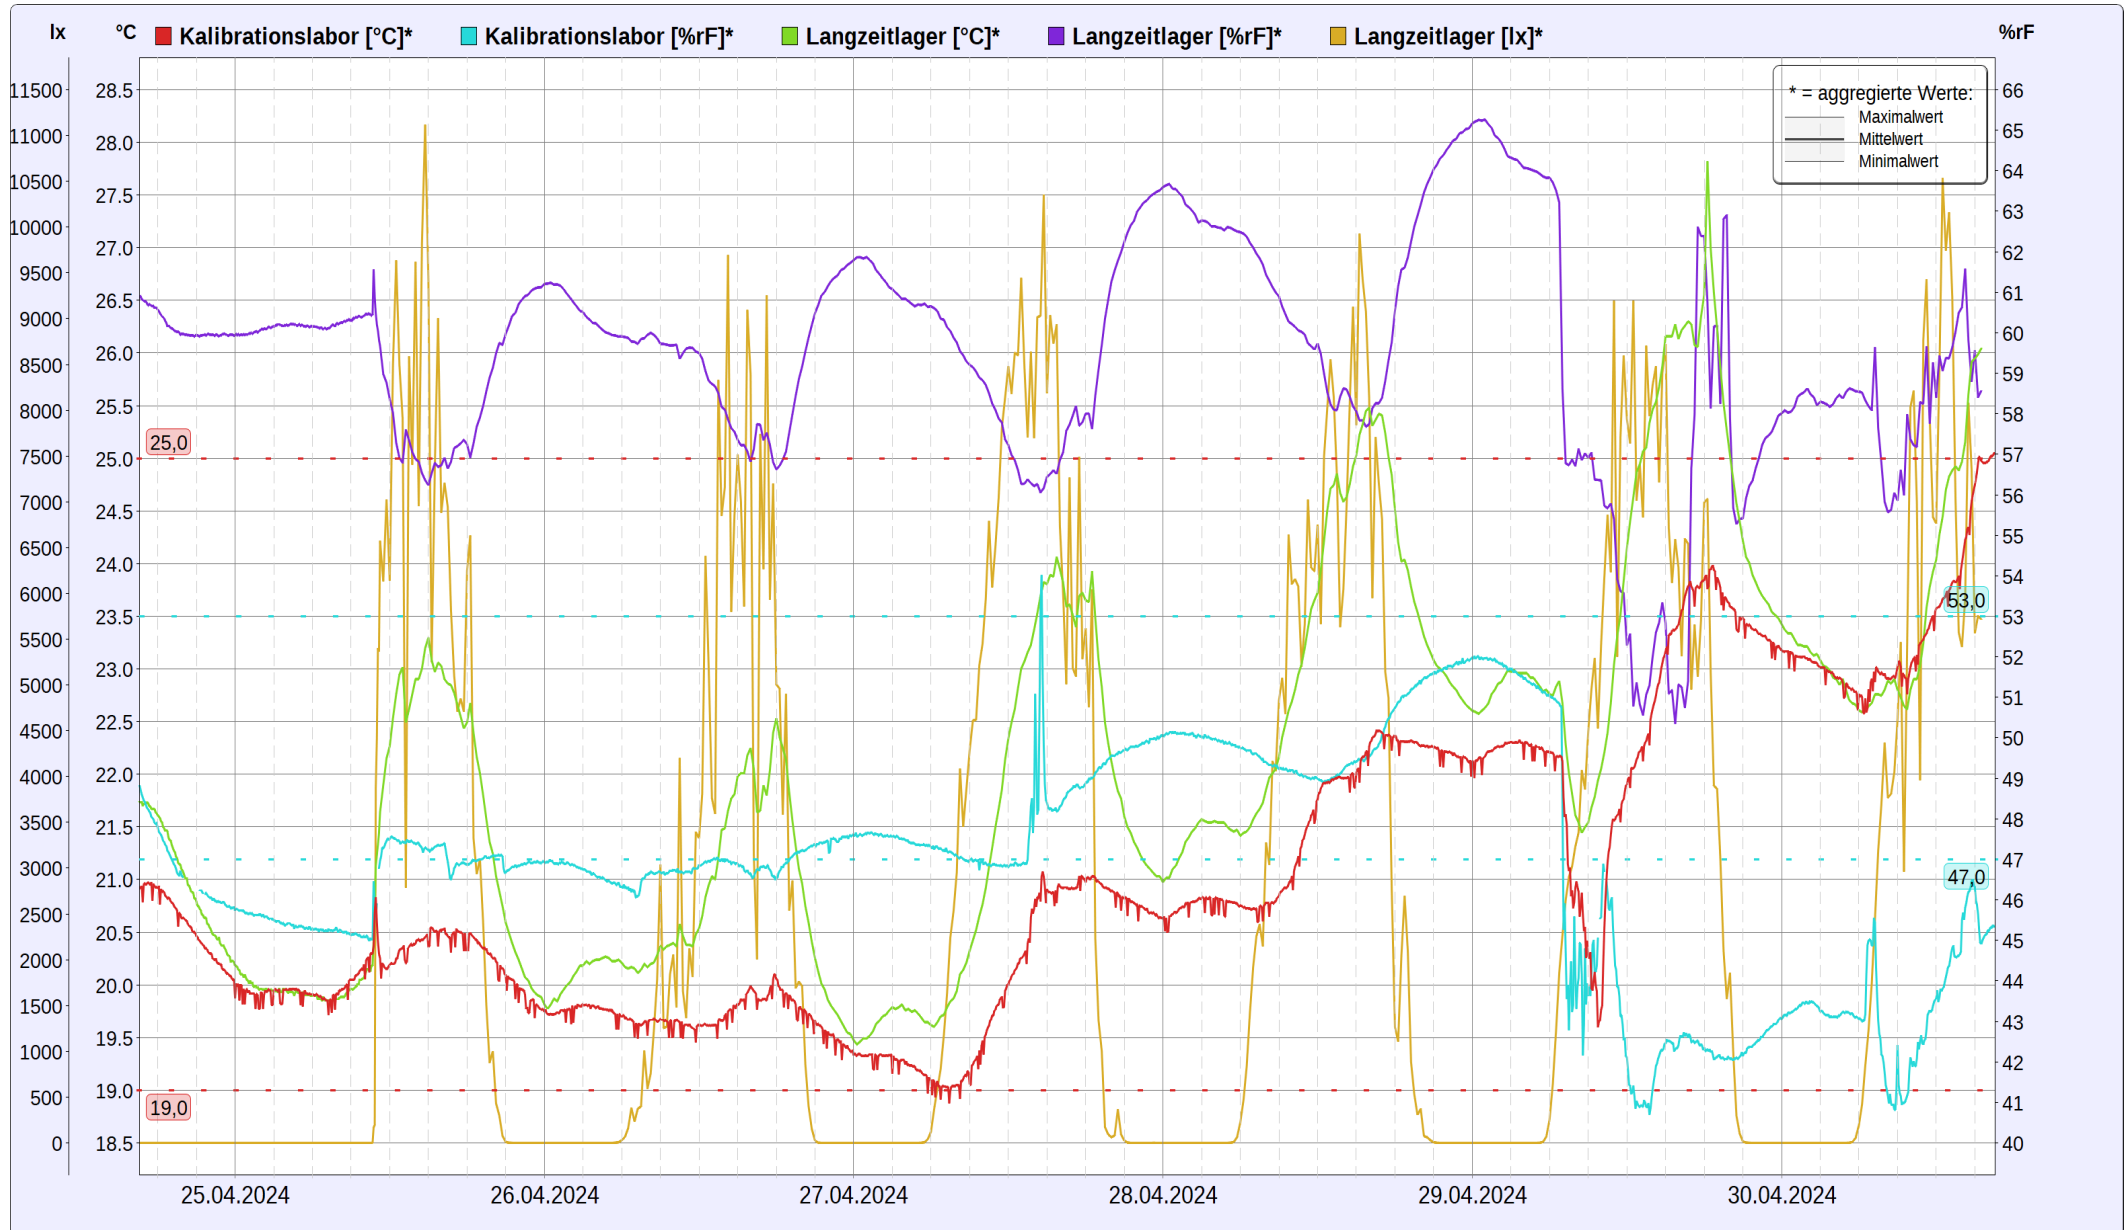



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16
Created by Account Owner

Alarmliste

Keine Alarme vorhanden.



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Messwerte

Ort Messstellengruppe Bereich		Kalibrationslabor [°C] Service Standort Hamburg WMT	Kalibrationslabor [%rF] Service Standort Hamburg WMT	Langzeitlager [°C] Lager / Logistik Standort Hamburg WMT	Langzeitlager [%rF] Lager / Logistik Standort Hamburg WMT	Langzeitlager [Ix] Lager / Logistik Standort Hamburg WMT
Unterer Grenzwert		19,0	47,0			
Oberer Grenzwert		25,0	53,0			
Mittelwert		21,1	46,9	21,7	59,6	2176,6
Minimalwert		18,9	40,7	19,4	50,3	0,0
Maximalwert		25,1	54,0	27,8	65,3	11118,3
24.04.2024	16:35:00	20,9	48,8	21,7	60,9	0,0
24.04.2024	16:40:00	20,9	48,7	21,7	60,9	0,0
24.04.2024	16:45:00	20,9	48,6	21,7	60,8	0,0
24.04.2024	16:50:00	20,8	48,5	21,7	60,8	0,0
24.04.2024	16:55:00	21,0	48,5	21,7	60,8	0,0
24.04.2024	17:00:00	21,0	48,4	21,7	60,8	0,1
24.04.2024	17:05:00	20,9	48,3	21,7	60,8	0,0
24.04.2024	17:10:00	21,0	48,3	21,7	60,7	0,0
24.04.2024	17:15:00	21,0	48,2	21,7	60,7	0,0
24.04.2024	17:20:00	21,0	48,2	21,7	60,7	0,0
24.04.2024	17:25:00	20,9	48,1	21,7	60,7	0,0
24.04.2024	17:30:00	21,0	48,1	21,7	60,7	0,0
24.04.2024	17:35:00	20,8	48,0	21,7	60,7	0,0
24.04.2024	17:40:00	21,0	48,0	21,7	60,7	0,0
24.04.2024	17:45:00	20,9	47,9	21,7	60,6	0,0
24.04.2024	17:50:00	20,9	47,9	21,6	60,6	0,0
24.04.2024	17:55:00	20,9	47,9	21,6	60,6	0,0
24.04.2024	18:00:00	20,9	47,8	21,6	60,6	0,0
24.04.2024	18:05:00	20,9	47,7	21,6	60,5	0,0
24.04.2024	18:10:00	20,8	47,6	21,6	60,5	0,0
24.04.2024	18:15:00	20,9	47,6	21,6	60,4	0,0
24.04.2024	18:20:00	20,9	47,5	21,5	60,4	0,0
24.04.2024	18:25:00	20,9	47,5	21,5	60,4	0,0
24.04.2024	18:30:00	20,9	47,4	21,5	60,4	0,0
24.04.2024	18:35:00	20,8	47,4	21,5	60,3	0,0
24.04.2024	18:40:00	20,8	47,3	21,5	60,2	0,0
24.04.2024	18:45:00	20,8	47,2	21,5	60,2	0,0
24.04.2024	18:50:00	20,8	47,2	21,4	60,2	0,0
24.04.2024	18:55:00	20,8	47,1	21,4	60,1	0,0
24.04.2024	19:00:00	20,8	47,1	21,4	60,1	0,0
24.04.2024	19:05:00	20,8	47,0	21,3	60,1	0,0
24.04.2024	19:10:00	20,8	46,9	21,3	60,1	0,0
24.04.2024	19:15:00	20,8	46,9	21,3	60,1	0,0
24.04.2024	19:20:00	20,7	46,8	21,3	60,0	0,0
24.04.2024	19:25:00	20,7	46,8	21,2	60,0	0,0
24.04.2024	19:30:00	20,7	46,7	21,2	60,0	0,0
24.04.2024	19:35:00	20,6	46,6	21,2	60,0	0,0



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
24.04.2024	19:40:00	20,7	46,6	21,1	60,0	0,0
24.04.2024	19:45:00	20,7	46,7	21,1	59,9	0,1
24.04.2024	19:50:00	20,6	46,6	21,1	60,0	0,1
24.04.2024	19:55:00	20,6	46,6	21,1	60,0	0,0
24.04.2024	20:00:00	20,6	46,6	21,1	60,0	0,0
24.04.2024	20:05:00	20,6	###	21,0	60,0	0,0
24.04.2024	20:10:00	20,6	###	21,0	60,0	0,0
24.04.2024	20:15:00	20,6	###	21,0	60,0	0,0
24.04.2024	20:20:00	20,6	###	20,9	59,9	0,0
24.04.2024	20:25:00	20,6	###	20,9	59,9	0,0
24.04.2024	20:30:00	20,6	###	20,9	59,9	0,0
24.04.2024	20:35:00	20,6	###	20,9	59,9	0,0
24.04.2024	20:40:00	20,5	###	20,9	59,9	0,0
24.04.2024	20:45:00	20,5	###	20,9	59,9	0,0
24.04.2024	20:50:00	20,5	###	20,8	59,9	0,0
24.04.2024	20:55:00	20,5	###	20,8	59,9	0,0
24.04.2024	21:00:00	20,5	###	20,8	59,9	0,0
24.04.2024	21:05:00	20,5	###	20,7	59,9	0,0
24.04.2024	21:10:00	20,4	###	20,7	59,9	0,0
24.04.2024	21:15:00	20,4	46,2	20,7	59,9	0,0
24.04.2024	21:20:00	20,4	46,3	20,7	59,9	0,0
24.04.2024	21:25:00	20,4	46,2	20,7	59,9	0,0
24.04.2024	21:30:00	20,4	46,2	20,7	59,9	0,0
24.04.2024	21:35:00	20,4	###	20,6	59,9	0,0
24.04.2024	21:40:00	20,3	46,2	20,6	60,0	0,0
24.04.2024	21:45:00	20,3	46,2	20,6	59,9	0,0
24.04.2024	21:50:00	20,3	46,1	20,6	60,0	0,0
24.04.2024	21:55:00	20,3	46,1	20,6	60,0	0,0
24.04.2024	22:00:00	20,3	46,1	20,6	60,0	0,0
24.04.2024	22:05:00	20,3	46,1	20,5	60,0	0,0
24.04.2024	22:10:00	20,3	46,1	20,5	59,9	0,0
24.04.2024	22:15:00	20,3	46,0	20,5	60,0	0,0
24.04.2024	22:20:00	20,2	46,0	20,5	59,9	0,0
24.04.2024	22:25:00	20,2	46,0	20,5	59,9	0,0
24.04.2024	22:30:00	20,3	46,0	20,5	60,0	0,0
24.04.2024	22:35:00	20,2	45,9	20,4	60,0	0,0
24.04.2024	22:40:00	20,2	46,0	20,4	59,9	0,0
24.04.2024	22:45:00	20,2	45,9	20,5	59,9	0,1
24.04.2024	22:50:00	20,2	45,9	20,4	59,9	0,0
24.04.2024	22:55:00	20,2	45,9	20,4	59,9	0,0
24.04.2024	23:00:00	20,2	45,9	20,4	60,0	0,0
24.04.2024	23:05:00	20,1	46,0	20,4	60,0	0,0
24.04.2024	23:10:00	20,1	45,9	20,4	60,0	0,0
24.04.2024	23:15:00	20,1	45,9	20,3	60,0	0,0
24.04.2024	23:20:00	20,1	45,9	20,3	60,0	0,0
24.04.2024	23:25:00	20,1	45,8	20,3	59,9	0,0
24.04.2024	23:30:00	20,1	45,8	20,3	59,9	0,0
24.04.2024	23:35:00	20,1	45,8	20,3	60,0	0,0
24.04.2024	23:40:00	20,1	45,8	20,2	60,0	0,1
24.04.2024	23:45:00	20,1	45,8	20,2	60,0	0,0



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
24.04.2024	23:50:00	20,0	45,8	20,2	59,9	0,0
24.04.2024	23:55:00	20,1	45,8	20,2	59,9	0,0
25.04.2024	00:00:00	19,9	45,7	20,2	59,9	0,0
25.04.2024	00:05:00	20,0	45,8	20,2	60,0	0,0
25.04.2024	00:10:00	20,0	45,8	20,2	59,9	0,0
25.04.2024	00:15:00	20,0	45,7	20,1	60,0	0,0
25.04.2024	00:20:00	19,9	45,7	20,1	59,9	0,0
25.04.2024	00:25:00	20,0	45,7	20,1	59,9	0,0
25.04.2024	00:30:00	20,0	45,7	20,1	60,0	0,0
25.04.2024	00:35:00	19,8	45,7	20,1	59,9	0,0
25.04.2024	00:40:00	20,0	45,7	20,1	60,0	0,0
25.04.2024	00:45:00	19,8	45,7	20,1	59,9	0,0
25.04.2024	00:50:00	19,9	45,7	20,1	60,0	0,0
25.04.2024	00:55:00	20,0	45,7	20,0	60,0	0,0
25.04.2024	01:00:00	19,9	45,7	20,0	60,0	0,0
25.04.2024	01:05:00	19,9	45,7	20,0	60,0	0,0
25.04.2024	01:10:00	19,9	45,7	20,0	60,0	0,0
25.04.2024	01:15:00	19,9	45,7	20,0	60,0	0,0
25.04.2024	01:20:00	19,9	45,7	20,0	60,0	0,0
25.04.2024	01:25:00	19,9	45,6	20,0	60,0	0,0
25.04.2024	01:30:00	19,9	45,6	20,0	60,0	0,0
25.04.2024	01:35:00	19,8	45,7	20,0	60,0	0,0
25.04.2024	01:40:00	19,9	45,6	20,0	60,0	0,0
25.04.2024	01:45:00	19,9	45,7	20,0	60,0	0,1
25.04.2024	01:50:00	19,8	45,6	20,0	60,0	0,0
25.04.2024	01:55:00	19,8	45,7	20,0	60,1	0,0
25.04.2024	02:00:00	19,9	45,6	20,0	60,1	0,0
25.04.2024	02:05:00	19,9	45,6	20,0	60,1	0,0
25.04.2024	02:10:00	19,8	45,6	20,0	60,1	0,0
25.04.2024	02:15:00	19,9	45,6	20,0	60,1	0,0
25.04.2024	02:20:00	19,9	45,6	20,0	60,1	0,0
25.04.2024	02:25:00	19,9	45,6	20,0	60,1	0,0
25.04.2024	02:30:00	19,9	45,6	19,9	60,1	0,0
25.04.2024	02:35:00	20,0	45,5	20,0	60,2	0,0
25.04.2024	02:40:00	19,9	45,5	19,9	60,1	0,0
25.04.2024	02:45:00	19,9	45,6	20,0	60,1	0,0
25.04.2024	02:50:00	19,8	45,5	20,0	60,1	0,0
25.04.2024	02:55:00	19,8	45,5	19,9	60,1	0,1
25.04.2024	03:00:00	19,9	45,5	19,9	60,2	0,0
25.04.2024	03:05:00	20,0	45,5	19,9	60,2	0,0
25.04.2024	03:10:00	20,0	45,5	19,9	60,2	0,0
25.04.2024	03:15:00	19,9	45,5	19,9	60,2	0,0
25.04.2024	03:20:00	19,9	45,5	19,9	60,2	0,0
25.04.2024	03:25:00	20,0	45,5	20,0	60,2	0,0
25.04.2024	03:30:00	19,8	45,4	19,9	60,2	0,0
25.04.2024	03:35:00	19,8	45,4	19,9	60,2	0,0
25.04.2024	03:40:00	19,8	45,4	19,9	60,2	0,0
25.04.2024	03:45:00	20,0	45,4	20,0	60,1	0,1
25.04.2024	03:50:00	19,9	45,4	20,0	60,2	0,0
25.04.2024	03:55:00	20,0	45,4	20,0	60,2	0,0



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
25.04.2024	04:00:00	20,0	45,4	19,9	60,2	0,0
25.04.2024	04:05:00	19,9	45,4	19,9	60,2	0,0
25.04.2024	04:10:00	20,0	45,4	19,9	60,2	0,0
25.04.2024	04:15:00	20,0	45,4	20,0	60,2	0,0
25.04.2024	04:20:00	20,0	45,4	19,9	60,2	0,0
25.04.2024	04:25:00	20,0	45,4	19,9	60,2	0,0
25.04.2024	04:30:00	20,0	45,4	19,9	60,2	0,0
25.04.2024	04:35:00	20,0	45,3	19,9	60,2	0,0
25.04.2024	04:40:00	20,0	45,3	19,9	60,2	0,0
25.04.2024	04:45:00	20,0	45,4	20,0	60,2	0,0
25.04.2024	04:50:00	20,0	45,3	19,9	60,2	0,0
25.04.2024	04:55:00	20,0	45,4	19,9	60,2	0,0
25.04.2024	05:00:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	05:05:00	19,8	45,3	19,9	60,2	0,0
25.04.2024	05:10:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	05:15:00	19,8	45,3	19,9	60,2	0,0
25.04.2024	05:20:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	05:25:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	05:30:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	05:35:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	05:40:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	05:45:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	05:50:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	05:55:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	06:00:00	19,9	45,3	19,9	60,2	0,1
25.04.2024	06:05:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	06:10:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	06:15:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	06:20:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	06:25:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	06:30:00	19,9	45,2	19,9	60,1	0,0
25.04.2024	06:35:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	06:40:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	06:45:00	19,9	45,2	19,8	60,1	0,0
25.04.2024	06:50:00	19,9	45,3	19,9	60,1	0,0
25.04.2024	06:55:00	19,9	45,2	19,9	60,1	0,0
25.04.2024	07:00:00	19,9	45,2	19,9	60,1	0,0
25.04.2024	07:05:00	19,9	45,2	19,9	60,1	0,1
25.04.2024	07:10:00	19,9	45,2	19,8	60,1	0,0
25.04.2024	07:15:00	19,7	45,3	19,9	60,1	0,0
25.04.2024	07:20:00	19,9	45,2	19,8	60,1	0,0
25.04.2024	07:25:00	19,9	45,2	19,9	60,1	0,0
25.04.2024	07:30:00	19,7	45,2	19,8	60,2	0,0
25.04.2024	07:35:00	19,9	45,2	19,9	60,2	0,0
25.04.2024	07:40:00	19,9	45,2	19,9	60,2	0,0
25.04.2024	07:45:00	19,8	45,3	19,9	60,1	0,1
25.04.2024	07:50:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	07:55:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	08:00:00	19,9	45,2	19,9	60,2	0,0
25.04.2024	08:05:00	19,9	45,3	19,9	60,2	0,0



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
25.04.2024	08:10:00	19,9	45,3	19,9	60,2	0,0
25.04.2024	08:15:00	20,0	45,2	19,9	60,3	0,0
25.04.2024	08:20:00	20,0	45,2	19,9	60,2	0,0
25.04.2024	08:25:00	20,0	45,2	19,9	60,3	0,0
25.04.2024	08:30:00	20,0	45,2	19,9	60,3	0,0
25.04.2024	08:35:00	20,0	45,2	19,9	60,3	0,0
25.04.2024	08:40:00	20,0	45,2	19,9	60,3	0,0
25.04.2024	08:45:00	19,9	45,2	19,9	60,3	0,0
25.04.2024	08:50:00	20,0	45,2	19,9	60,3	0,0
25.04.2024	08:55:00	20,0	45,1	20,0	60,3	0,0
25.04.2024	09:00:00	20,0	45,1	20,0	60,3	0,0
25.04.2024	09:05:00	20,0	45,1	20,0	60,3	0,0
25.04.2024	09:10:00	20,0	45,1	20,0	60,4	0,0
25.04.2024	09:15:00	20,0	45,2	20,0	60,3	0,0
25.04.2024	09:20:00	20,1	45,2	20,0	60,4	0,0
25.04.2024	09:25:00	20,1	45,2	20,0	60,4	0,0
25.04.2024	09:30:00	20,1	45,1	20,0	60,4	0,0
25.04.2024	09:35:00	20,1	45,1	20,0	60,4	0,0
25.04.2024	09:40:00	20,1	45,1	20,1	60,4	0,0
25.04.2024	09:45:00	20,1	45,1	20,0	60,4	0,0
25.04.2024	09:50:00	20,2	45,1	20,1	60,4	0,0
25.04.2024	09:55:00	20,1	45,1	20,1	60,4	0,0
25.04.2024	10:00:00	20,2	45,1	20,1	60,4	0,0
25.04.2024	10:05:00	20,1	45,1	20,1	60,4	0,0
25.04.2024	10:10:00	20,2	45,1	20,1	60,5	0,0
25.04.2024	10:15:00	20,3	45,1	20,2	60,4	0,1
25.04.2024	10:20:00	20,3	45,0	20,1	60,5	0,0
25.04.2024	10:25:00	20,1	45,0	20,1	60,5	0,0
25.04.2024	10:30:00	20,3	45,1	20,1	60,5	0,0
25.04.2024	10:35:00	20,3	45,0	20,2	60,4	0,0
25.04.2024	10:40:00	20,3	45,0	20,2	60,5	0,0
25.04.2024	10:45:00	20,4	46,5	20,4	61,6	166,2
25.04.2024	10:50:00	20,7	45,8	20,7	60,9	197,0
25.04.2024	10:55:00	20,8	45,5	21,1	60,5	3881,8
25.04.2024	11:00:00	20,6	45,9	21,2	60,2	4419,1
25.04.2024	11:05:00	20,4	###	21,3	60,1	5397,6
25.04.2024	11:10:00	20,3	46,8	21,4	59,8	5365,7
25.04.2024	11:15:00	20,3	47,0	21,6	59,7	6572,7
25.04.2024	11:20:00	20,1	47,1			
25.04.2024	11:25:00	20,2	47,3			
25.04.2024	11:30:00	20,2	47,3	21,9	59,0	6128,8
25.04.2024	11:35:00	20,2	47,3			
25.04.2024	11:40:00	20,2	47,4			
25.04.2024	11:45:00	20,2	47,5	22,2	58,8	7027,2
25.04.2024	11:50:00	20,2	47,5			
25.04.2024	11:55:00	20,2	47,5			
25.04.2024	12:00:00	20,2	47,5	22,3	58,4	6145,1
25.04.2024	12:05:00	20,2	47,6			
25.04.2024	12:10:00	20,2	47,6			
25.04.2024	12:15:00	20,2	47,5	22,5	58,0	8494,4



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
25.04.2024	12:20:00	20,2	47,5			
25.04.2024	12:25:00	20,2	47,5			
25.04.2024	12:30:00	20,3	47,5	22,8	57,3	9632,2
25.04.2024	12:35:00	20,2	47,5			
25.04.2024	12:40:00	20,3	47,5			
25.04.2024	12:45:00	20,3	47,5	22,9	56,9	8495,9
25.04.2024	12:50:00	20,3	47,4			
25.04.2024	12:55:00	20,3	47,4			
25.04.2024	13:00:00	20,3	47,4	23,0	56,8	7911,4
25.04.2024	13:05:00	20,4	47,4			
25.04.2024	13:10:00	20,2	47,4			
25.04.2024	13:15:00	20,2	47,4	22,5	57,6	2784,5
25.04.2024	13:20:00	20,2	47,5			
25.04.2024	13:25:00	20,3	47,4			
25.04.2024	13:30:00	20,4	47,4	22,6	57,3	8586,6
25.04.2024	13:35:00	20,4	47,4			
25.04.2024	13:40:00	20,4	47,5			
25.04.2024	13:45:00	20,4	47,4	22,8	57,1	7409,8
25.04.2024	13:50:00	20,4	47,4			
25.04.2024	13:55:00	20,4	47,4			
25.04.2024	14:00:00	20,4	47,4	22,9	56,9	9615,7
25.04.2024	14:05:00	20,4	47,4			
25.04.2024	14:10:00	20,4	47,4			
25.04.2024	14:15:00	20,4	47,4	22,9	56,8	6957,6
25.04.2024	14:20:00	20,4	47,3			
25.04.2024	14:25:00	20,4	47,3			
25.04.2024	14:30:00	20,4	47,3	23,0	56,5	9825,8
25.04.2024	14:35:00	20,4	47,2			
25.04.2024	14:40:00	20,4	47,3			
25.04.2024	14:45:00	20,5	47,3	23,2	56,4	11118,3
25.04.2024	14:50:00	20,5	47,3			
25.04.2024	14:55:00	20,5	47,2			
25.04.2024	15:00:00	20,4	47,3	23,3	56,2	9409,1
25.04.2024	15:05:00	20,4	47,2			
25.04.2024	15:10:00	20,5	47,2			
25.04.2024	15:15:00	20,5	47,3	23,1	56,5	5247,6
25.04.2024	15:20:00	20,5	47,2			
25.04.2024	15:25:00	20,5	47,3			
25.04.2024	15:30:00	20,5	47,3	23,0	56,8	7380,3
25.04.2024	15:35:00	20,5	47,3			
25.04.2024	15:40:00	20,5	47,3			
25.04.2024	15:45:00	20,4	47,4	23,1	56,7	9001,8
25.04.2024	15:50:00	20,5	47,3			
25.04.2024	15:55:00	20,5	47,3			
25.04.2024	16:00:00	20,5	47,4	23,0	56,7	6882,1
25.04.2024	16:05:00	20,5	47,4			
25.04.2024	16:10:00	20,5	47,4			
25.04.2024	16:15:00	20,5	47,4	22,9	56,9	7206,6
25.04.2024	16:20:00	20,5	47,3			
25.04.2024	16:25:00	20,5	47,1			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
25.04.2024	16:30:00	20,5	46,9	22,9	56,6	6947,2
25.04.2024	16:35:00	20,4	46,8			
25.04.2024	16:40:00	20,5	46,5			
25.04.2024	16:45:00	20,3	46,5	22,8	56,8	5826,7
25.04.2024	16:50:00	20,5	46,6			
25.04.2024	16:55:00	20,5	46,6			
25.04.2024	17:00:00	20,5	46,8	22,8	57,2	5098,7
25.04.2024	17:05:00	20,4	46,8			
25.04.2024	17:10:00	20,5	46,9			
25.04.2024	17:15:00	20,5	46,9	22,7	57,2	4711,6
25.04.2024	17:20:00	20,5	46,9			
25.04.2024	17:25:00	20,5	46,9			
25.04.2024	17:30:00	20,5	46,9	22,5	57,3	4850,3
25.04.2024	17:35:00	20,5	46,9			
25.04.2024	17:40:00	20,5	46,9			
25.04.2024	17:45:00	20,3	46,9	22,4	57,4	4709,2
25.04.2024	17:50:00	20,5	46,9			
25.04.2024	17:55:00	20,3	46,9			
25.04.2024	18:00:00	20,3	46,9	22,5	57,2	6250,4
25.04.2024	18:05:00	20,3	46,9			
25.04.2024	18:10:00	20,5	46,9			
25.04.2024	18:15:00	20,5	46,9	22,7	56,9	6630,2
25.04.2024	18:20:00	20,5	46,9			
25.04.2024	18:25:00	20,5	47,0			
25.04.2024	18:30:00	20,5	47,0	22,4	57,3	3325,7
25.04.2024	18:35:00	20,4	47,0			
25.04.2024	18:40:00	20,4	46,9			
25.04.2024	18:45:00	20,4	47,0	22,2	57,7	2934,2
25.04.2024	18:50:00	20,4	47,0			
25.04.2024	18:55:00	20,4	47,0			
25.04.2024	19:00:00	20,4	47,0	22,0	57,9	3101,5
25.04.2024	19:05:00	20,4	47,0			
25.04.2024	19:10:00	20,4	47,0			
25.04.2024	19:15:00	20,3	47,0	21,8	58,2	2396,8
25.04.2024	19:20:00	20,4	47,1			
25.04.2024	19:25:00	20,3	47,1			
25.04.2024	19:30:00	20,3	47,1	21,6	58,6	1494,9
25.04.2024	19:35:00	20,3	47,0			
25.04.2024	19:40:00	20,3	47,0			
25.04.2024	19:45:00	20,3	47,0	21,4	58,9	876,0
25.04.2024	19:50:00	20,3	47,1			
25.04.2024	19:55:00	20,3	47,1			
25.04.2024	20:00:00	20,3	47,1	21,2	59,1	1001,7
25.04.2024	20:05:00	20,3	47,1			
25.04.2024	20:10:00	20,3	47,1			
25.04.2024	20:15:00	20,2	47,1	21,0	59,5	431,8
25.04.2024	20:20:00	20,2	47,1			
25.04.2024	20:25:00	20,1	47,1			
25.04.2024	20:30:00	20,0	47,1	20,9	59,7	300,4
25.04.2024	20:35:00	20,2	47,1			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
25.04.2024	20:40:00	20,1	47,1			
25.04.2024	20:45:00	20,2	47,1	20,7	59,7	77,9
25.04.2024	20:50:00	20,1	46,8			
25.04.2024	20:55:00	20,1	46,7			
25.04.2024	21:00:00	20,1	46,7	20,6	60,0	9,8
25.04.2024	21:05:00	19,9	46,7			
25.04.2024	21:10:00	20,1	46,7			
25.04.2024	21:15:00	20,1	46,7	20,5	60,2	1,1
25.04.2024	21:20:00	20,1	46,8			
25.04.2024	21:25:00	20,1	46,8			
25.04.2024	21:30:00	20,0	46,8	20,4	60,4	0,3
25.04.2024	21:35:00	20,0	46,8			
25.04.2024	21:40:00	20,0	46,8			
25.04.2024	21:45:00	19,9	46,9	20,3	60,5	0,0
25.04.2024	21:50:00	20,0	46,8			
25.04.2024	21:55:00	20,0	46,8			
25.04.2024	22:00:00	19,8	46,8	20,2	60,7	0,0
25.04.2024	22:05:00	20,0	46,8			
25.04.2024	22:10:00	20,0	46,9			
25.04.2024	22:15:00	20,0	46,9	20,2	60,8	0,0
25.04.2024	22:20:00	19,9	46,9			
25.04.2024	22:25:00	19,9	46,9			
25.04.2024	22:30:00	19,9	46,9	20,1	60,9	0,0
25.04.2024	22:35:00	19,8	46,9			
25.04.2024	22:40:00	19,8	46,9			
25.04.2024	22:45:00	19,7	46,9	20,0	60,9	0,1
25.04.2024	22:50:00	19,7	46,9			
25.04.2024	22:55:00	19,9	46,9			
25.04.2024	23:00:00	19,9	46,9	20,0	61,0	0,1
25.04.2024	23:05:00	19,9	46,9			
25.04.2024	23:10:00	19,9	46,9			
25.04.2024	23:15:00	19,7	46,9	19,9	61,1	0,2
25.04.2024	23:20:00	19,8	46,9			
25.04.2024	23:25:00	19,8	47,0			
25.04.2024	23:30:00	19,8	46,9	19,9	61,1	0,1
25.04.2024	23:35:00	19,8	46,9			
25.04.2024	23:40:00	19,8	46,9			
25.04.2024	23:45:00	19,8	46,9	19,9	61,1	0,0
25.04.2024	23:50:00	19,8	46,9			
25.04.2024	23:55:00	19,8	47,0			
26.04.2024	00:00:00	19,7	46,9	19,8	61,2	0,2
26.04.2024	00:05:00	19,8	46,9			
26.04.2024	00:10:00	19,7	46,9			
26.04.2024	00:15:00	19,7	46,9	19,8	61,2	0,0
26.04.2024	00:20:00	19,7	46,9			
26.04.2024	00:25:00	19,7	47,0			
26.04.2024	00:30:00	19,7	46,9	19,8	61,2	0,0
26.04.2024	00:35:00	19,7	47,0			
26.04.2024	00:40:00	19,7	46,9			
26.04.2024	00:45:00	19,7	46,9	19,9	61,2	0,0



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
26.04.2024	00:50:00	19,7	46,9			
26.04.2024	00:55:00	19,7	46,9			
26.04.2024	01:00:00	19,7	46,9	19,8	61,2	0,0
26.04.2024	01:05:00	19,7	46,9			
26.04.2024	01:10:00	19,7	46,9			
26.04.2024	01:15:00	19,8	46,9	19,9	61,2	0,0
26.04.2024	01:20:00	19,8	46,9			
26.04.2024	01:25:00	19,8	46,9			
26.04.2024	01:30:00	19,8	46,9	20,0	61,1	0,0
26.04.2024	01:35:00	19,8	46,9			
26.04.2024	01:40:00	19,6	46,9			
26.04.2024	01:45:00	19,8	46,9	20,0	61,0	0,0
26.04.2024	01:50:00	19,8	46,9			
26.04.2024	01:55:00	19,8	46,9			
26.04.2024	02:00:00	19,8	46,9	20,0	60,9	0,0
26.04.2024	02:05:00	19,6	46,9			
26.04.2024	02:10:00	19,8	46,9			
26.04.2024	02:15:00	19,6	46,8	20,1	60,8	0,0
26.04.2024	02:20:00	19,8	46,9			
26.04.2024	02:25:00	19,8	46,8			
26.04.2024	02:30:00	19,8	46,8	20,1	60,7	0,1
26.04.2024	02:35:00	19,8	46,8			
26.04.2024	02:40:00	19,8	46,8			
26.04.2024	02:45:00	19,8	46,8	20,2	60,5	0,0
26.04.2024	02:50:00	19,8	46,8			
26.04.2024	02:55:00	19,8	46,8			
26.04.2024	03:00:00	19,8	46,8	20,2	60,5	0,2
26.04.2024	03:05:00	19,8	46,8			
26.04.2024	03:10:00	19,8	46,8			
26.04.2024	03:15:00	19,8	46,7	20,2	60,4	0,0
26.04.2024	03:20:00	19,8	46,7			
26.04.2024	03:25:00	19,8	46,7			
26.04.2024	03:30:00	19,8	46,7	20,2	60,3	0,2
26.04.2024	03:35:00	19,8	46,7			
26.04.2024	03:40:00	19,8	46,6			
26.04.2024	03:45:00	19,8	46,7	20,2	60,2	0,0
26.04.2024	03:50:00	19,8	46,7			
26.04.2024	03:55:00	19,8	46,6			
26.04.2024	04:00:00	19,8	46,6	20,2	60,2	0,1
26.04.2024	04:05:00	19,8	46,6			
26.04.2024	04:10:00	19,8	46,6			
26.04.2024	04:15:00	19,8	46,6	20,2	60,1	0,0
26.04.2024	04:20:00	19,8	46,5			
26.04.2024	04:25:00	19,8	46,5			
26.04.2024	04:30:00	19,8	46,6	20,3	60,1	0,1
26.04.2024	04:35:00	19,8	46,5			
26.04.2024	04:40:00	19,8	46,5			
26.04.2024	04:45:00	19,8	46,5	20,3	60,0	0,0
26.04.2024	04:50:00	19,8	46,5			
26.04.2024	04:55:00	19,8	46,5			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
26.04.2024	05:00:00	19,8	46,5	20,3	60,0	0,0
26.04.2024	05:05:00	19,8	46,4			
26.04.2024	05:10:00	19,8	46,4			
26.04.2024	05:15:00	19,8	46,4	20,2	59,9	0,0
26.04.2024	05:20:00	19,7	46,4			
26.04.2024	05:25:00	19,7	46,4			
26.04.2024	05:30:00	19,7	46,4	20,2	59,9	1,3
26.04.2024	05:35:00	19,6	46,4			
26.04.2024	05:40:00	19,7	46,4			
26.04.2024	05:45:00	19,6	46,4	20,2	59,9	7,1
26.04.2024	05:50:00	19,7	46,4			
26.04.2024	05:55:00	19,7	46,3			
26.04.2024	06:00:00	19,7	46,3	20,2	59,9	27,7
26.04.2024	06:05:00	19,7	46,3			
26.04.2024	06:10:00	19,7	46,4			
26.04.2024	06:15:00	19,7	46,3	20,2	59,9	63,1
26.04.2024	06:20:00	19,7	46,3			
26.04.2024	06:25:00	19,7	46,3			
26.04.2024	06:30:00	19,7	46,3	20,2	59,9	159,8
26.04.2024	06:35:00	19,7	46,2			
26.04.2024	06:40:00	19,7	46,3			
26.04.2024	06:45:00	19,7	46,2	20,2	59,8	381,4
26.04.2024	06:50:00	19,7	46,3			
26.04.2024	06:55:00	19,7	46,2			
26.04.2024	07:00:00	19,5	46,2	20,2	59,8	232,6
26.04.2024	07:05:00	19,6	46,1			
26.04.2024	07:10:00	19,6	46,1			
26.04.2024	07:15:00	19,5	46,1	20,1	59,7	375,0
26.04.2024	07:20:00	19,6	46,1			
26.04.2024	07:25:00	19,6	46,2			
26.04.2024	07:30:00	19,6	46,4	20,1	59,8	396,4
26.04.2024	07:35:00	19,6	46,5			
26.04.2024	07:40:00	19,6	46,5			
26.04.2024	07:45:00	19,7	46,5	20,2	59,9	1007,9
26.04.2024	07:50:00	19,7	46,6			
26.04.2024	07:55:00	19,7	46,6			
26.04.2024	08:00:00	19,5	46,6	20,2	59,9	593,5
26.04.2024	08:05:00	19,7	46,7			
26.04.2024	08:10:00	19,7	46,6			
26.04.2024	08:15:00	19,7	46,7	20,2	60,0	758,4
26.04.2024	08:20:00	19,7	46,7			
26.04.2024	08:25:00	19,7	46,7			
26.04.2024	08:30:00	19,7	46,6	20,2	59,9	1235,0
26.04.2024	08:35:00	19,7	46,6			
26.04.2024	08:40:00	19,7	46,7			
26.04.2024	08:45:00	19,7	46,7	20,3	59,9	1783,1
26.04.2024	08:50:00	19,7	46,7			
26.04.2024	08:55:00	19,7	46,7			
26.04.2024	09:00:00	19,7	46,7	20,4	59,7	3033,2
26.04.2024	09:05:00	19,7	46,7			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
26.04.2024	09:10:00	19,7	46,7			
26.04.2024	09:15:00	19,7	46,7	20,3	59,7	1254,7
26.04.2024	09:20:00	19,7	46,6			
26.04.2024	09:25:00	19,7	46,6			
26.04.2024	09:30:00	19,7	46,7	20,4	59,7	1269,3
26.04.2024	09:35:00	19,6	46,7			
26.04.2024	09:40:00	19,5	46,7			
26.04.2024	09:45:00	19,7	46,7	20,4	59,7	1841,6
26.04.2024	09:50:00	19,7	46,7			
26.04.2024	09:55:00	19,5	46,7			
26.04.2024	10:00:00	19,5	46,7	20,4	59,7	2052,2
26.04.2024	10:05:00	19,7	46,8			
26.04.2024	10:10:00	19,7	46,7			
26.04.2024	10:15:00	19,7	46,7	20,4	59,7	1477,9
26.04.2024	10:20:00	19,7	46,8			
26.04.2024	10:25:00	19,7	46,7			
26.04.2024	10:30:00	19,6	46,7	20,6	59,4	4205,5
26.04.2024	10:35:00	19,5	46,7			
26.04.2024	10:40:00	19,6	46,7			
26.04.2024	10:45:00	19,5	46,7	20,5	59,5	1655,8
26.04.2024	10:50:00	19,6	46,7			
26.04.2024	10:55:00	19,6	46,7			
26.04.2024	11:00:00	19,6	46,7	20,4	59,6	1368,3
26.04.2024	11:05:00	19,6	46,7			
26.04.2024	11:10:00	19,6	46,7			
26.04.2024	11:15:00	19,6	46,7	20,4	59,6	2123,5
26.04.2024	11:20:00	19,6	46,7			
26.04.2024	11:25:00	19,6	46,7			
26.04.2024	11:30:00	19,6	46,8	20,4	59,6	1810,5
26.04.2024	11:35:00	19,6	46,8			
26.04.2024	11:40:00	19,6	46,7			
26.04.2024	11:45:00	19,5	46,8	20,5	59,5	3394,4
26.04.2024	11:50:00	19,6	46,8			
26.04.2024	11:55:00	19,6	46,8			
26.04.2024	12:00:00	19,6	46,9	20,5	59,5	3324,5
26.04.2024	12:05:00	19,6	46,8			
26.04.2024	12:10:00	19,6	46,9			
26.04.2024	12:15:00	19,6	46,9	20,7	59,4	3813,4
26.04.2024	12:20:00	19,6	46,9			
26.04.2024	12:25:00	19,6	46,9			
26.04.2024	12:30:00	19,6	46,9	20,8	59,1	6408,0
26.04.2024	12:35:00	19,6	46,9			
26.04.2024	12:40:00	19,6	46,9			
26.04.2024	12:45:00	19,6	47,0	20,9	58,8	5193,6
26.04.2024	12:50:00	19,6	46,9			
26.04.2024	12:55:00	19,6	47,0			
26.04.2024	13:00:00	19,6	47,0	21,0	58,7	3764,4
26.04.2024	13:05:00	19,6	47,0			
26.04.2024	13:10:00	19,6	47,0			
26.04.2024	13:15:00	19,6	47,0	21,0	58,7	3592,6



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
26.04.2024	13:20:00	19,6	47,0			
26.04.2024	13:25:00	19,5	47,1			
26.04.2024	13:30:00	19,7	47,0	21,2	58,5	8328,6
26.04.2024	13:35:00	19,7	47,0			
26.04.2024	13:40:00	19,7	47,0			
26.04.2024	13:45:00	19,7	47,0	21,5	58,2	6846,2
26.04.2024	13:50:00	19,7	47,0			
26.04.2024	13:55:00	19,7	47,0			
26.04.2024	14:00:00	19,7	47,0	21,5	58,1	7158,1
26.04.2024	14:05:00	19,7	47,0			
26.04.2024	14:10:00	19,6	47,0			
26.04.2024	14:15:00	19,7	47,0	21,7	57,9	9690,8
26.04.2024	14:20:00	19,8	46,9			
26.04.2024	14:25:00	19,8	47,0			
26.04.2024	14:30:00	19,8	46,9	21,8	57,6	5797,2
26.04.2024	14:35:00	19,6	46,9			
26.04.2024	14:40:00	19,8	46,9			
26.04.2024	14:45:00	19,8	46,9	21,8	57,6	6860,7
26.04.2024	14:50:00	19,8	46,9			
26.04.2024	14:55:00	19,8	46,9			
26.04.2024	15:00:00	19,8	46,9	22,0	57,4	7510,8
26.04.2024	15:05:00	19,8	46,8			
26.04.2024	15:10:00	19,8	46,8			
26.04.2024	15:15:00	19,9	46,9	22,0	57,2	7004,9
26.04.2024	15:20:00	19,9	46,8			
26.04.2024	15:25:00	19,9	46,8			
26.04.2024	15:30:00	19,9	46,7	22,0	57,2	5859,5
26.04.2024	15:35:00	19,8	46,7			
26.04.2024	15:40:00	19,9	46,7			
26.04.2024	15:45:00	19,9	46,7	22,2	57,1	9098,8
26.04.2024	15:50:00	19,9	46,7			
26.04.2024	15:55:00	20,0	46,6			
26.04.2024	16:00:00	20,0	46,7	22,2	56,8	8388,2
26.04.2024	16:05:00	20,0	46,6			
26.04.2024	16:10:00	20,0	46,5			
26.04.2024	16:15:00	19,9	46,6	22,1	57,1	3155,1
26.04.2024	16:20:00	19,9	46,6			
26.04.2024	16:25:00	19,9	46,7			
26.04.2024	16:30:00	19,8	46,8	21,6	57,7	2007,1
26.04.2024	16:35:00	19,9	46,8			
26.04.2024	16:40:00	19,9	46,7			
26.04.2024	16:45:00	19,9	46,8	21,7	57,7	7738,1
26.04.2024	16:50:00	19,9	46,8			
26.04.2024	16:55:00	19,9	46,8			
26.04.2024	17:00:00	19,9	46,8	21,9	57,4	6270,1
26.04.2024	17:05:00	19,9	46,8			
26.04.2024	17:10:00	19,9	46,8			
26.04.2024	17:15:00	19,9	46,8	21,8	57,5	9254,8
26.04.2024	17:20:00	19,9	46,9			
26.04.2024	17:25:00	19,9	46,8			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
26.04.2024	17:30:00	20,0	46,7	22,0	57,2	5936,4
26.04.2024	17:35:00	20,0	46,7			
26.04.2024	17:40:00	19,9	46,6			
26.04.2024	17:45:00	20,1	46,6	22,4	56,8	7197,6
26.04.2024	17:50:00	20,1	46,6			
26.04.2024	17:55:00	20,1	46,5			
26.04.2024	18:00:00	20,1	46,6	22,5	56,6	5006,7
26.04.2024	18:05:00	20,0	46,5			
26.04.2024	18:10:00	20,0	46,7			
26.04.2024	18:15:00	20,0	46,7	22,4	56,7	4960,4
26.04.2024	18:20:00	19,9	46,7			
26.04.2024	18:25:00	20,0	46,8			
26.04.2024	18:30:00	19,9	46,8	22,2	56,9	3585,7
26.04.2024	18:35:00	19,8	46,9			
26.04.2024	18:40:00	19,9	46,9			
26.04.2024	18:45:00	19,9	46,9	22,1	57,1	4904,0
26.04.2024	18:50:00	19,9	46,9			
26.04.2024	18:55:00	19,8	46,9			
26.04.2024	19:00:00	19,9	47,0	21,8	57,5	2535,8
26.04.2024	19:05:00	19,9	47,0			
26.04.2024	19:10:00	19,9	47,1			
26.04.2024	19:15:00	19,9	47,1	21,6	58,0	2865,2
26.04.2024	19:20:00	19,9	47,1			
26.04.2024	19:25:00	19,8	47,1			
26.04.2024	19:30:00	19,8	47,2	21,3	58,4	1688,8
26.04.2024	19:35:00	19,7	47,1			
26.04.2024	19:40:00	19,7	47,2			
26.04.2024	19:45:00	19,8	47,1	21,1	58,9	1760,7
26.04.2024	19:50:00	19,8	47,2			
26.04.2024	19:55:00	19,8	47,2			
26.04.2024	20:00:00	19,8	47,2	21,0	59,2	1710,2
26.04.2024	20:05:00	19,6	47,2			
26.04.2024	20:10:00	19,8	47,2			
26.04.2024	20:15:00	19,8	47,2	20,7	59,5	859,0
26.04.2024	20:20:00	19,7	47,2			
26.04.2024	20:25:00	19,6	47,3			
26.04.2024	20:30:00	19,7	47,3	20,6	59,9	399,6
26.04.2024	20:35:00	19,7	47,3			
26.04.2024	20:40:00	19,7	47,3			
26.04.2024	20:45:00	19,7	47,3	20,4	60,2	152,5
26.04.2024	20:50:00	19,7	47,3			
26.04.2024	20:55:00	19,5	47,4			
26.04.2024	21:00:00	19,7	47,3	20,3	60,5	24,1
26.04.2024	21:05:00	19,6	47,3			
26.04.2024	21:10:00	19,6	47,4			
26.04.2024	21:15:00	19,6	47,4	20,1	60,7	1,5
26.04.2024	21:20:00	19,6	47,4			
26.04.2024	21:25:00	19,6	47,4			
26.04.2024	21:30:00	19,6	47,4	20,0	60,9	0,0
26.04.2024	21:35:00	19,6	47,4			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
26.04.2024	21:40:00	19,4	47,4			
26.04.2024	21:45:00	19,6	47,4	20,0	61,0	0,2
26.04.2024	21:50:00	19,6	47,4			
26.04.2024	21:55:00	19,4	47,5			
26.04.2024	22:00:00	19,6	47,5	19,9	61,2	0,0
26.04.2024	22:05:00	19,5	47,1			
26.04.2024	22:10:00	19,5	47,2			
26.04.2024	22:15:00	19,5	47,5	19,8	61,3	0,0
26.04.2024	22:20:00	19,5	47,5			
26.04.2024	22:25:00	19,5	47,5			
26.04.2024	22:30:00	19,5	47,5	19,8	61,4	0,0
26.04.2024	22:35:00	19,3	47,5			
26.04.2024	22:40:00	19,5	47,4			
26.04.2024	22:45:00	19,5	47,4	19,7	61,4	0,0
26.04.2024	22:50:00	19,5	47,4			
26.04.2024	22:55:00	19,4	47,5			
26.04.2024	23:00:00	19,5	47,5	19,7	61,5	0,2
26.04.2024	23:05:00	19,3	47,6			
26.04.2024	23:10:00	19,4	47,6			
26.04.2024	23:15:00	19,4	47,6	19,6	61,6	0,0
26.04.2024	23:20:00	19,4	47,6			
26.04.2024	23:25:00	19,4	47,6			
26.04.2024	23:30:00	19,4	47,6	19,5	61,7	0,1
26.04.2024	23:35:00	19,4	47,5			
26.04.2024	23:40:00	19,4	47,6			
26.04.2024	23:45:00	19,4	47,6	19,5	61,7	0,0
26.04.2024	23:50:00	19,4	47,6			
26.04.2024	23:55:00	19,4	47,6			
27.04.2024	00:00:00	19,3	47,6	19,5	61,8	0,0
27.04.2024	00:05:00	19,4	47,6			
27.04.2024	00:10:00	19,3	47,7			
27.04.2024	00:15:00	19,3	47,6	19,4	61,9	0,0
27.04.2024	00:20:00	19,3	47,6			
27.04.2024	00:25:00	19,3	47,6			
27.04.2024	00:30:00	19,3	47,6	19,5	61,9	0,0
27.04.2024	00:35:00	19,3	47,6			
27.04.2024	00:40:00	19,3	47,6			
27.04.2024	00:45:00	19,3	47,6	19,5	61,8	0,2
27.04.2024	00:50:00	19,3	47,6			
27.04.2024	00:55:00	19,3	47,6			
27.04.2024	01:00:00	19,3	47,6	19,5	61,9	0,0
27.04.2024	01:05:00	19,3	47,7			
27.04.2024	01:10:00	19,3	47,6			
27.04.2024	01:15:00	19,3	47,6	19,5	61,8	0,0
27.04.2024	01:20:00	19,3	47,7			
27.04.2024	01:25:00	19,3	47,7			
27.04.2024	01:30:00	19,2	47,6	19,6	61,7	0,1
27.04.2024	01:35:00	19,2	47,6			
27.04.2024	01:40:00	19,3	47,7			
27.04.2024	01:45:00	19,3	47,6	19,6	61,5	0,2



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
27.04.2024	01:50:00	19,2	47,6			
27.04.2024	01:55:00	19,3	47,6			
27.04.2024	02:00:00	19,3	47,6	19,7	61,5	0,1
27.04.2024	02:05:00	19,3	47,6			
27.04.2024	02:10:00	19,3	47,6			
27.04.2024	02:15:00	19,3	47,6	19,7	61,3	0,0
27.04.2024	02:20:00	19,3	47,6			
27.04.2024	02:25:00	19,3	47,6			
27.04.2024	02:30:00	19,3	47,6	19,7	61,3	0,0
27.04.2024	02:35:00	19,3	47,6			
27.04.2024	02:40:00	19,3	47,6			
27.04.2024	02:45:00	19,3	47,5	19,8	61,1	0,0
27.04.2024	02:50:00	19,3	47,6			
27.04.2024	02:55:00	19,3	47,6			
27.04.2024	03:00:00	19,2	47,5	19,8	61,1	0,1
27.04.2024	03:05:00	19,3	47,6			
27.04.2024	03:10:00	19,3	47,6			
27.04.2024	03:15:00	19,3	47,5	19,8	61,0	0,0
27.04.2024	03:20:00	19,3	47,6			
27.04.2024	03:25:00	19,3	47,6			
27.04.2024	03:30:00	19,2	47,5	19,8	60,9	0,1
27.04.2024	03:35:00	19,3	47,5			
27.04.2024	03:40:00	19,3	47,5			
27.04.2024	03:45:00	19,3	47,5	19,8	60,8	0,0
27.04.2024	03:50:00	19,3	47,5			
27.04.2024	03:55:00	19,3	47,5			
27.04.2024	04:00:00	19,2	47,5	19,8	60,8	0,0
27.04.2024	04:05:00	19,3	47,5			
27.04.2024	04:10:00	19,2	47,5			
27.04.2024	04:15:00	19,2	47,4	19,8	60,8	0,2
27.04.2024	04:20:00	19,2	47,4			
27.04.2024	04:25:00	19,2	47,4			
27.04.2024	04:30:00	19,2	47,4	19,7	60,7	0,0
27.04.2024	04:35:00	19,2	47,4			
27.04.2024	04:40:00	19,2	47,4			
27.04.2024	04:45:00	19,2	47,4	19,8	60,7	0,2
27.04.2024	04:50:00	19,2	47,4			
27.04.2024	04:55:00	19,2	47,4			
27.04.2024	05:00:00	19,2	47,4	19,7	60,7	0,0
27.04.2024	05:05:00	19,2	47,4			
27.04.2024	05:10:00	19,2	47,3			
27.04.2024	05:15:00	19,2	47,4	19,7	60,7	0,7
27.04.2024	05:20:00	19,2	47,3			
27.04.2024	05:25:00	19,1	47,4			
27.04.2024	05:30:00	19,1	47,4	19,6	60,7	7,1
27.04.2024	05:35:00	19,1	47,3			
27.04.2024	05:40:00	19,1	47,4			
27.04.2024	05:45:00	19,0	47,3	19,6	60,6	39,1
27.04.2024	05:50:00	19,1	47,4			
27.04.2024	05:55:00	19,1	47,3			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
27.04.2024	06:00:00	19,1	47,3	19,6	60,7	123,0
27.04.2024	06:05:00	19,0	47,3			
27.04.2024	06:10:00	19,1	47,3			
27.04.2024	06:15:00	19,1	47,3	19,6	60,6	373,4
27.04.2024	06:20:00	18,9	47,3			
27.04.2024	06:25:00	19,1	47,3			
27.04.2024	06:30:00	19,1	47,3	19,6	60,5	595,8
27.04.2024	06:35:00	19,0	47,3			
27.04.2024	06:40:00	19,0	47,3			
27.04.2024	06:45:00	18,9	47,3	19,7	60,3	806,5
27.04.2024	06:50:00	19,0	47,2			
27.04.2024	06:55:00	19,0	47,2			
27.04.2024	07:00:00	19,0	47,2	19,7	60,3	1180,5
27.04.2024	07:05:00	19,0	47,2			
27.04.2024	07:10:00	19,0	47,3			
27.04.2024	07:15:00	19,0	47,2	19,8	60,1	1638,1
27.04.2024	07:20:00	19,0	47,2			
27.04.2024	07:25:00	18,9	47,2			
27.04.2024	07:30:00	19,0	47,2	19,8	60,0	2243,5
27.04.2024	07:35:00	19,0	47,2			
27.04.2024	07:40:00	19,0	47,2			
27.04.2024	07:45:00	19,0	47,1	19,9	59,9	2530,1
27.04.2024	07:50:00	19,0	47,1			
27.04.2024	07:55:00	19,0	47,1			
27.04.2024	08:00:00	19,1	47,1	19,9	59,8	2954,6
27.04.2024	08:05:00	19,0	47,1			
27.04.2024	08:10:00	19,0	47,0			
27.04.2024	08:15:00	18,9	47,0	20,1	59,5	4089,8
27.04.2024	08:20:00	19,1	47,1			
27.04.2024	08:25:00	19,1	47,0			
27.04.2024	08:30:00	19,1	47,0	20,1	59,4	3450,8
27.04.2024	08:35:00	19,1	47,0			
27.04.2024	08:40:00	19,1	47,0			
27.04.2024	08:45:00	19,1	47,0	20,2	59,3	3867,7
27.04.2024	08:50:00	19,2	47,0			
27.04.2024	08:55:00	19,2	46,9			
27.04.2024	09:00:00	19,1	47,0	20,3	59,2	4283,2
27.04.2024	09:05:00	19,1	47,0			
27.04.2024	09:10:00	19,2	47,0			
27.04.2024	09:15:00	19,2	46,9	20,4	59,2	4612,5
27.04.2024	09:20:00	19,3	47,0			
27.04.2024	09:25:00	19,3	47,0			
27.04.2024	09:30:00	19,3	47,0	20,5	59,0	4619,5
27.04.2024	09:35:00	19,3	47,0			
27.04.2024	09:40:00	19,2	47,0			
27.04.2024	09:45:00	19,4	46,7	20,7	58,9	5215,7
27.04.2024	09:50:00	19,2	46,9			
27.04.2024	09:55:00	19,4	46,9			
27.04.2024	10:00:00	19,5	47,0	20,8	58,8	5449,3
27.04.2024	10:05:00	19,3	46,9			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
27.04.2024	10:10:00	19,5	46,9			
27.04.2024	10:15:00	19,5	46,9	20,9	58,7	5941,9
27.04.2024	10:20:00	19,6	46,9			
27.04.2024	10:25:00	19,6	46,9			
27.04.2024	10:30:00	19,6	46,9	21,1	58,5	6788,6
27.04.2024	10:35:00	19,7	46,8			
27.04.2024	10:40:00	19,7	46,8			
27.04.2024	10:45:00	19,7	46,9	21,3	58,3	6063,3
27.04.2024	10:50:00	19,7	46,9			
27.04.2024	10:55:00	19,8	46,9			
27.04.2024	11:00:00	19,8	46,9	21,5	58,1	6514,4
27.04.2024	11:05:00	19,8	46,9			
27.04.2024	11:10:00	19,8	46,8			
27.04.2024	11:15:00	19,8	46,9	21,7	57,9	7039,6
27.04.2024	11:20:00	19,9	46,8			
27.04.2024	11:25:00	19,9	46,9			
27.04.2024	11:30:00	19,9	46,8	21,9	57,8	7808,1
27.04.2024	11:35:00	19,8	46,8			
27.04.2024	11:40:00	19,8	46,9			
27.04.2024	11:45:00	19,9	46,8	22,1	57,4	8137,1
27.04.2024	11:50:00	20,0	46,8			
27.04.2024	11:55:00	20,0	46,9			
27.04.2024	12:00:00	20,0	46,8	22,3	57,2	8482,2
27.04.2024	12:05:00	20,0	46,8			
27.04.2024	12:10:00	20,0	46,9			
27.04.2024	12:15:00	20,1	46,9	22,5	57,0	8182,8
27.04.2024	12:20:00	20,1	46,9			
27.04.2024	12:25:00	20,1	46,8			
27.04.2024	12:30:00	20,1	46,9	22,6	56,9	8625,8
27.04.2024	12:35:00	20,1	46,9			
27.04.2024	12:40:00	20,2	46,9			
27.04.2024	12:45:00	20,2	46,8	22,8	56,6	8601,9
27.04.2024	12:50:00	20,2	46,9			
27.04.2024	12:55:00	20,3	46,9			
27.04.2024	13:00:00	20,3	46,9	23,0	56,3	9445,6
27.04.2024	13:05:00	20,3	46,9			
27.04.2024	13:10:00	20,3	46,9			
27.04.2024	13:15:00	20,3	46,9	23,1	56,3	8468,4
27.04.2024	13:20:00	20,3	46,9			
27.04.2024	13:25:00	20,2	46,9			
27.04.2024	13:30:00	20,4	47,0	23,2	56,4	7705,5
27.04.2024	13:35:00	20,4	47,5			
27.04.2024	13:40:00	20,4	47,8			
27.04.2024	13:45:00	20,6	48,3	23,2	56,3	8636,6
27.04.2024	13:50:00	20,7	48,5			
27.04.2024	13:55:00	20,7	47,7			
27.04.2024	14:00:00	20,7	48,3	23,4	56,2	7699,9
27.04.2024	14:05:00	20,8	51,1			
27.04.2024	14:10:00	20,7	49,6			
27.04.2024	14:15:00	20,8	48,1	23,5	56,3	9017,1



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
27.04.2024	14:20:00	20,8	48,2			
27.04.2024	14:25:00	20,9	50,6			
27.04.2024	14:30:00	20,8	53,2	23,7	56,1	9030,5
27.04.2024	14:35:00	21,0	54,0			
27.04.2024	14:40:00	21,1	51,4			
27.04.2024	14:45:00	21,0	49,8	23,8	56,2	10349,1
27.04.2024	14:50:00	20,9	48,9			
27.04.2024	14:55:00	20,8	48,5			
27.04.2024	15:00:00	20,9	48,4	23,8	56,4	8191,0
27.04.2024	15:05:00	20,9	48,3			
27.04.2024	15:10:00	20,9	48,2			
27.04.2024	15:15:00	20,9	48,3	23,9	56,5	9035,0
27.04.2024	15:20:00	20,9	48,3			
27.04.2024	15:25:00	20,9	48,2			
27.04.2024	15:30:00	20,9	48,2	23,9	56,6	8728,0
27.04.2024	15:35:00	20,7	48,2			
27.04.2024	15:40:00	20,9	48,3			
27.04.2024	15:45:00	20,8	48,2	24,1	56,5	8936,9
27.04.2024	15:50:00	20,9	48,2			
27.04.2024	15:55:00	21,0	48,2			
27.04.2024	16:00:00	20,9	48,3	24,0	56,9	6740,4
27.04.2024	16:05:00	20,9	48,3			
27.04.2024	16:10:00	20,9	48,4			
27.04.2024	16:15:00	20,9	48,4	23,8	57,0	6008,0
27.04.2024	16:20:00	20,9	48,5			
27.04.2024	16:25:00	20,9	48,5			
27.04.2024	16:30:00	20,9	48,6	23,6	57,6	5008,4
27.04.2024	16:35:00	20,9	48,7			
27.04.2024	16:40:00	20,9	48,7			
27.04.2024	16:45:00	20,9	48,7	23,6	57,7	7267,0
27.04.2024	16:50:00	20,9	48,7			
27.04.2024	16:55:00	20,9	48,7			
27.04.2024	17:00:00	20,9	48,8	23,5	58,0	5186,0
27.04.2024	17:05:00	20,9	48,8			
27.04.2024	17:10:00	20,9	48,8			
27.04.2024	17:15:00	20,9	48,8	23,4	58,2	5094,2
27.04.2024	17:20:00	20,9	48,9			
27.04.2024	17:25:00	21,0	48,8			
27.04.2024	17:30:00	21,0	48,8	23,7	57,7	7486,8
27.04.2024	17:35:00	20,9	48,8			
27.04.2024	17:40:00	21,0	48,8			
27.04.2024	17:45:00	21,0	48,8	23,7	57,8	5280,8
27.04.2024	17:50:00	21,0	48,8			
27.04.2024	17:55:00	21,0	48,8			
27.04.2024	18:00:00	21,0	48,9	23,7	58,0	5614,2
27.04.2024	18:05:00	21,0	48,9			
27.04.2024	18:10:00	21,0	48,9			
27.04.2024	18:15:00	21,0	49,0	23,6	58,0	4760,5
27.04.2024	18:20:00	21,0	49,0			
27.04.2024	18:25:00	21,0	49,0			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
27.04.2024	18:30:00	21,0	49,0	23,9	57,6	6037,7
27.04.2024	18:35:00	21,0	49,0			
27.04.2024	18:40:00	21,0	49,1			
27.04.2024	18:45:00	21,0	49,1	23,5	58,4	2231,8
27.04.2024	18:50:00	21,0	49,2			
27.04.2024	18:55:00	21,0	49,2			
27.04.2024	19:00:00	21,0	49,3	23,1	59,1	1337,6
27.04.2024	19:05:00	21,0	49,3			
27.04.2024	19:10:00	21,0	49,3			
27.04.2024	19:15:00	21,0	49,3	22,8	59,7	1004,7
27.04.2024	19:20:00	20,9	49,3			
27.04.2024	19:25:00	20,9	49,4			
27.04.2024	19:30:00	20,9	49,3	22,5	60,3	173,4
27.04.2024	19:35:00	20,9	49,4			
27.04.2024	19:40:00	20,9	49,4			
27.04.2024	19:45:00	20,9	49,5	22,3	60,8	91,5
27.04.2024	19:50:00	20,9	49,5			
27.04.2024	19:55:00	20,9	49,5			
27.04.2024	20:00:00	20,9	49,6	22,1	61,3	62,5
27.04.2024	20:05:00	20,9	49,6			
27.04.2024	20:10:00	20,9	49,6			
27.04.2024	20:15:00	20,9	49,6	22,0	61,5	79,4
27.04.2024	20:20:00	20,7	49,6			
27.04.2024	20:25:00	20,9	49,6			
27.04.2024	20:30:00	20,9	49,6	21,8	61,8	366,1
27.04.2024	20:35:00	20,8	49,7			
27.04.2024	20:40:00	20,8	49,6			
27.04.2024	20:45:00	20,7	49,6	21,8	62,0	92,6
27.04.2024	20:50:00	20,8	49,7			
27.04.2024	20:55:00	20,8	49,7			
27.04.2024	21:00:00	20,8	49,7	21,6	62,2	24,4
27.04.2024	21:05:00	20,8	49,7			
27.04.2024	21:10:00	20,8	49,7			
27.04.2024	21:15:00	20,7	49,7	21,5	62,5	2,8
27.04.2024	21:20:00	20,8	49,7			
27.04.2024	21:25:00	20,8	49,8			
27.04.2024	21:30:00	20,8	49,8	21,4	62,7	0,0
27.04.2024	21:35:00	20,8	49,8			
27.04.2024	21:40:00	20,8	49,8			
27.04.2024	21:45:00	20,8	49,8	21,4	62,8	0,0
27.04.2024	21:50:00	20,8	49,8			
27.04.2024	21:55:00	20,8	49,8			
27.04.2024	22:00:00	20,8	49,8	21,3	63,0	0,1
27.04.2024	22:05:00	20,6	49,8			
27.04.2024	22:10:00	20,8	49,8			
27.04.2024	22:15:00	20,7	49,8	21,2	63,1	0,1
27.04.2024	22:20:00	20,7	49,8			
27.04.2024	22:25:00	20,7	49,9			
27.04.2024	22:30:00	20,7	49,8	21,2	63,2	0,0
27.04.2024	22:35:00	20,7	49,9			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
27.04.2024	22:40:00	20,7	49,9			
27.04.2024	22:45:00	20,7	49,9	21,1	63,3	0,1
27.04.2024	22:50:00	20,7	49,9			
27.04.2024	22:55:00	20,7	49,9			
27.04.2024	23:00:00	20,7	50,0	21,1	63,4	0,0
27.04.2024	23:05:00	20,7	49,9			
27.04.2024	23:10:00	20,7	50,0			
27.04.2024	23:15:00	20,7	49,9	21,1	63,4	0,3
27.04.2024	23:20:00	20,7	50,0			
27.04.2024	23:25:00	20,7	50,0			
27.04.2024	23:30:00	20,7	50,0	21,0	63,5	0,2
27.04.2024	23:35:00	20,6	50,0			
27.04.2024	23:40:00	20,6	50,0			
27.04.2024	23:45:00	20,6	50,0	21,0	63,5	0,0
27.04.2024	23:50:00	20,6	50,1			
27.04.2024	23:55:00	20,6	50,1			
28.04.2024	00:00:00	20,6	50,1	21,0	63,6	0,0
28.04.2024	00:05:00	20,6	50,0			
28.04.2024	00:10:00	20,5	50,1			
28.04.2024	00:15:00	20,6	50,1	21,0	63,6	0,0
28.04.2024	00:20:00	20,5	50,1			
28.04.2024	00:25:00	20,5	50,1			
28.04.2024	00:30:00	20,7	50,1	21,0	63,7	0,0
28.04.2024	00:35:00	20,6	50,2			
28.04.2024	00:40:00	20,7	50,1			
28.04.2024	00:45:00	20,7	50,1	21,1	63,6	0,0
28.04.2024	00:50:00	20,7	50,1			
28.04.2024	00:55:00	20,7	50,2			
28.04.2024	01:00:00	20,7	50,1	21,1	63,5	0,1
28.04.2024	01:05:00	20,7	50,1			
28.04.2024	01:10:00	20,7	50,1			
28.04.2024	01:15:00	20,7	50,1	21,2	63,4	0,2
28.04.2024	01:20:00	20,7	50,1			
28.04.2024	01:25:00	20,7	50,1			
28.04.2024	01:30:00	20,7	50,1	21,3	63,4	0,1
28.04.2024	01:35:00	20,7	50,1			
28.04.2024	01:40:00	20,7	50,1			
28.04.2024	01:45:00	20,8	50,1	21,4	63,2	0,0
28.04.2024	01:50:00	20,8	50,1			
28.04.2024	01:55:00	20,8	50,1			
28.04.2024	02:00:00	20,6	50,1	21,4	63,1	0,0
28.04.2024	02:05:00	20,8	50,1			
28.04.2024	02:10:00	20,8	50,1			
28.04.2024	02:15:00	20,8	50,1	21,5	63,0	0,0
28.04.2024	02:20:00	20,8	50,1			
28.04.2024	02:25:00	20,8	50,0			
28.04.2024	02:30:00	20,8	50,1	21,5	62,9	0,0
28.04.2024	02:35:00	20,8	50,0			
28.04.2024	02:40:00	20,8	50,1			
28.04.2024	02:45:00	20,8	50,1	21,5	62,7	0,1



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
28.04.2024	02:50:00	20,8	50,0			
28.04.2024	02:55:00	20,8	50,0			
28.04.2024	03:00:00	20,8	50,0	21,6	62,8	0,1
28.04.2024	03:05:00	20,8	50,0			
28.04.2024	03:10:00	20,8	50,0			
28.04.2024	03:15:00	20,7	50,1	21,6	62,8	0,1
28.04.2024	03:20:00	20,8	50,0			
28.04.2024	03:25:00	20,8	50,0			
28.04.2024	03:30:00	20,8	50,0	21,5	62,7	0,0
28.04.2024	03:35:00	20,8	50,0			
28.04.2024	03:40:00	20,8	50,0			
28.04.2024	03:45:00	20,7	50,0	21,5	62,6	0,0
28.04.2024	03:50:00	20,7	50,0			
28.04.2024	03:55:00	20,8	50,0			
28.04.2024	04:00:00	20,7	50,0	21,6	62,6	0,0
28.04.2024	04:05:00	20,8	50,0			
28.04.2024	04:10:00	20,8	49,9			
28.04.2024	04:15:00	20,8	49,9	21,5	62,6	0,0
28.04.2024	04:20:00	20,7	49,9			
28.04.2024	04:25:00	20,8	49,9			
28.04.2024	04:30:00	20,8	49,9	21,5	62,6	0,0
28.04.2024	04:35:00	20,8	49,9			
28.04.2024	04:40:00	20,8	49,9			
28.04.2024	04:45:00	20,7	49,8	21,5	62,5	0,0
28.04.2024	04:50:00	20,6	49,9			
28.04.2024	04:55:00	20,8	49,9			
28.04.2024	05:00:00	20,8	49,8	21,5	62,6	0,0
28.04.2024	05:05:00	20,8	49,9			
28.04.2024	05:10:00	20,8	49,9			
28.04.2024	05:15:00	20,8	49,8	21,5	62,6	1,2
28.04.2024	05:20:00	20,8	49,8			
28.04.2024	05:25:00	20,8	49,8			
28.04.2024	05:30:00	20,8	49,8	21,5	62,5	9,8
28.04.2024	05:35:00	20,8	49,8			
28.04.2024	05:40:00	20,8	49,8			
28.04.2024	05:45:00	20,8	49,8	21,5	62,5	62,4
28.04.2024	05:50:00	20,8	49,8			
28.04.2024	05:55:00	20,7	49,8			
28.04.2024	06:00:00	20,8	49,8	21,4	62,5	223,3
28.04.2024	06:05:00	20,8	49,7			
28.04.2024	06:10:00	20,7	49,8			
28.04.2024	06:15:00	20,7	49,7	21,4	62,4	466,9
28.04.2024	06:20:00	20,7	49,7			
28.04.2024	06:25:00	20,7	49,7			
28.04.2024	06:30:00	20,7	49,7	21,5	62,4	841,5
28.04.2024	06:35:00	20,7	49,7			
28.04.2024	06:40:00	20,7	49,7			
28.04.2024	06:45:00	20,7	49,7	21,5	62,2	1427,4
28.04.2024	06:50:00	20,7	49,7			
28.04.2024	06:55:00	20,7	49,6			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
28.04.2024	07:00:00	20,7	49,6	21,6	62,1	1920,4
28.04.2024	07:05:00	20,7	49,6			
28.04.2024	07:10:00	20,7	49,6			
28.04.2024	07:15:00	20,7	49,6	21,6	62,0	2256,3
28.04.2024	07:20:00	20,6	49,6			
28.04.2024	07:25:00	20,6	49,5			
28.04.2024	07:30:00	20,7	49,5	21,7	61,8	2384,1
28.04.2024	07:35:00	20,8	49,5			
28.04.2024	07:40:00	20,7	49,5			
28.04.2024	07:45:00	20,6	49,5	21,7	61,7	2149,1
28.04.2024	07:50:00	20,8	49,4			
28.04.2024	07:55:00	20,8	49,4			
28.04.2024	08:00:00	20,8	49,4	21,9	61,4	3280,2
28.04.2024	08:05:00	20,8	49,4			
28.04.2024	08:10:00	20,8	49,4			
28.04.2024	08:15:00	20,7	49,3	22,0	61,3	3040,1
28.04.2024	08:20:00	20,8	49,4			
28.04.2024	08:25:00	20,8	49,3			
28.04.2024	08:30:00	20,8	49,3	22,0	61,1	4165,6
28.04.2024	08:35:00	20,8	49,3			
28.04.2024	08:40:00	20,8	49,3			
28.04.2024	08:45:00	20,8	49,3	22,1	61,0	4064,9
28.04.2024	08:50:00	20,8	49,3			
28.04.2024	08:55:00	20,8	49,3			
28.04.2024	09:00:00	20,8	49,2	22,2	60,9	4832,1
28.04.2024	09:05:00	20,9	49,3			
28.04.2024	09:10:00	20,9	49,3			
28.04.2024	09:15:00	20,9	49,2	22,4	60,6	5077,1
28.04.2024	09:20:00	20,9	49,3			
28.04.2024	09:25:00	20,9	49,2			
28.04.2024	09:30:00	20,9	49,2	22,5	60,5	4683,7
28.04.2024	09:35:00	20,9	49,2			
28.04.2024	09:40:00	20,9	49,2			
28.04.2024	09:45:00	21,0	49,2	22,6	60,3	6636,9
28.04.2024	09:50:00	21,0	49,2			
28.04.2024	09:55:00	21,0	49,2			
28.04.2024	10:00:00	21,0	49,2	22,7	60,2	6102,4
28.04.2024	10:05:00	20,9	49,2			
28.04.2024	10:10:00	21,1	49,1			
28.04.2024	10:15:00	21,1	49,2	22,8	60,1	6156,1
28.04.2024	10:20:00	21,1	49,2			
28.04.2024	10:25:00	21,2	49,1			
28.04.2024	10:30:00	21,2	49,1	22,9	60,1	6077,1
28.04.2024	10:35:00	21,1	49,1			
28.04.2024	10:40:00	21,3	49,1			
28.04.2024	10:45:00	21,3	49,1	23,0	60,0	5203,9
28.04.2024	10:50:00	21,4	49,1			
28.04.2024	10:55:00	21,4	49,0			
28.04.2024	11:00:00	21,4	49,1	23,2	60,0	5660,1
28.04.2024	11:05:00	21,5	49,0			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
28.04.2024	11:10:00	21,5	49,0			
28.04.2024	11:15:00	21,5	49,0	23,4	59,7	7024,8
28.04.2024	11:20:00	21,6	49,0			
28.04.2024	11:25:00	21,6	49,0			
28.04.2024	11:30:00	21,6	49,0	23,6	59,7	6280,1
28.04.2024	11:35:00	21,6	49,0			
28.04.2024	11:40:00	21,7	49,0			
28.04.2024	11:45:00	21,5	49,0	23,7	59,6	6244,1
28.04.2024	11:50:00	21,6	49,0			
28.04.2024	11:55:00	21,7	49,0			
28.04.2024	12:00:00	21,8	49,0	23,7	59,7	6748,3
28.04.2024	12:05:00	21,8	49,0			
28.04.2024	12:10:00	21,8	49,0			
28.04.2024	12:15:00	21,9	48,9	23,9	59,5	5668,7
28.04.2024	12:20:00	21,9	48,9			
28.04.2024	12:25:00	21,9	48,9			
28.04.2024	12:30:00	21,9	48,9	24,2	59,0	7497,7
28.04.2024	12:35:00	21,9	48,9			
28.04.2024	12:40:00	21,9	48,9			
28.04.2024	12:45:00	21,9	49,0	24,5	58,5	8023,1
28.04.2024	12:50:00	21,9	49,0			
28.04.2024	12:55:00	21,9	49,0			
28.04.2024	13:00:00	21,9	49,0	24,7	58,2	8554,3
28.04.2024	13:05:00	22,0	49,0			
28.04.2024	13:10:00	22,0	49,0			
28.04.2024	13:15:00	21,9	49,0	24,7	58,1	8149,7
28.04.2024	13:20:00	22,0	49,0			
28.04.2024	13:25:00	22,0	49,1			
28.04.2024	13:30:00	22,0	49,1	24,9	58,1	7271,6
28.04.2024	13:35:00	22,0	49,1			
28.04.2024	13:40:00	22,0	49,1			
28.04.2024	13:45:00	22,0	49,1	24,7	58,4	5630,9
28.04.2024	13:50:00	22,0	49,1			
28.04.2024	13:55:00	22,0	49,2			
28.04.2024	14:00:00	22,0	49,2	24,6	58,6	6046,2
28.04.2024	14:05:00	22,0	49,3			
28.04.2024	14:10:00	22,0	49,3			
28.04.2024	14:15:00	22,0	49,3	24,6	58,6	6958,3
28.04.2024	14:20:00	22,0	49,3			
28.04.2024	14:25:00	22,0	49,3			
28.04.2024	14:30:00	21,8	49,3	24,8	58,4	8107,3
28.04.2024	14:35:00	22,0	49,4			
28.04.2024	14:40:00	22,0	49,4			
28.04.2024	14:45:00	22,0	49,4	24,9	58,2	9128,1
28.04.2024	14:50:00	21,9	49,4			
28.04.2024	14:55:00	21,9	49,4			
28.04.2024	15:00:00	22,0	49,4	25,0	58,1	7838,0
28.04.2024	15:05:00	22,0	49,4			
28.04.2024	15:10:00	22,1	49,5			
28.04.2024	15:15:00	21,9	49,5	25,2	57,8	9928,3



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
28.04.2024	15:20:00	22,1	49,4			
28.04.2024	15:25:00	22,2	49,5			
28.04.2024	15:30:00	22,2	49,5	25,3	57,8	9421,2
28.04.2024	15:35:00	22,2	49,4			
28.04.2024	15:40:00	22,2	49,5			
28.04.2024	15:45:00	22,2	49,5	25,5	57,7	9075,3
28.04.2024	15:50:00	22,2	49,6			
28.04.2024	15:55:00	22,1	49,5			
28.04.2024	16:00:00	22,3	49,5	25,5	57,7	8141,1
28.04.2024	16:05:00	22,3	49,6			
28.04.2024	16:10:00	22,3	49,6			
28.04.2024	16:15:00	22,3	49,6	25,3	58,1	5947,6
28.04.2024	16:20:00	22,4	49,7			
28.04.2024	16:25:00	22,4	49,7			
28.04.2024	16:30:00	22,4	49,7	25,4	58,3	7706,2
28.04.2024	16:35:00	22,4	49,8			
28.04.2024	16:40:00	22,4	49,8			
28.04.2024	16:45:00	22,4	49,8	25,4	58,3	7200,8
28.04.2024	16:50:00	22,4	49,9			
28.04.2024	16:55:00	22,4	49,9			
28.04.2024	17:00:00	22,4	50,1	25,4	58,4	6810,6
28.04.2024	17:05:00	22,4	50,1			
28.04.2024	17:10:00	22,2	50,2			
28.04.2024	17:15:00	22,4	50,3	25,2	58,8	5142,7
28.04.2024	17:20:00	22,4	50,4			
28.04.2024	17:25:00	22,4	50,4			
28.04.2024	17:30:00	22,4	50,5	25,0	59,3	4861,0
28.04.2024	17:35:00	22,4	50,5			
28.04.2024	17:40:00	22,4	50,6			
28.04.2024	17:45:00	22,2	50,6	24,8	59,8	2781,3
28.04.2024	17:50:00	22,3	50,7			
28.04.2024	17:55:00	22,4	50,7			
28.04.2024	18:00:00	22,4	50,7	24,5	60,5	1265,6
28.04.2024	18:05:00	22,4	50,8			
28.04.2024	18:10:00	22,3	50,8			
28.04.2024	18:15:00	22,3	50,9	24,2	61,1	1107,5
28.04.2024	18:20:00	22,2	50,9			
28.04.2024	18:25:00	22,3	50,9			
28.04.2024	18:30:00	22,3	51,0	24,0	61,6	2032,1
28.04.2024	18:35:00	22,3	51,0			
28.04.2024	18:40:00	22,3	51,0			
28.04.2024	18:45:00	22,3	51,1	24,0	61,6	2699,0
28.04.2024	18:50:00	22,3	51,0			
28.04.2024	18:55:00	22,3	51,1			
28.04.2024	19:00:00	22,3	51,1	23,9	61,9	2096,0
28.04.2024	19:05:00	22,3	51,1			
28.04.2024	19:10:00	22,3	51,1			
28.04.2024	19:15:00	22,3	51,2	23,8	62,2	885,0
28.04.2024	19:20:00	22,3	51,2			
28.04.2024	19:25:00	22,3	51,2			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
28.04.2024	19:30:00	22,3	51,2	23,6	62,6	532,3
28.04.2024	19:35:00	22,3	51,3			
28.04.2024	19:40:00	22,3	51,3			
28.04.2024	19:45:00	22,3	51,3	23,5	62,9	304,8
28.04.2024	19:50:00	22,3	51,3			
28.04.2024	19:55:00	22,3	51,4			
28.04.2024	20:00:00	22,3	51,3	23,4	63,2	371,4
28.04.2024	20:05:00	22,3	51,4			
28.04.2024	20:10:00	22,3	51,4			
28.04.2024	20:15:00	22,3	51,5	23,3	63,5	74,2
28.04.2024	20:20:00	22,3	51,5			
28.04.2024	20:25:00	22,3	51,4			
28.04.2024	20:30:00	22,3	51,5	23,2	63,7	61,2
28.04.2024	20:35:00	22,3	51,5			
28.04.2024	20:40:00	22,3	51,5			
28.04.2024	20:45:00	22,3	51,6	23,2	63,8	29,3
28.04.2024	20:50:00	22,3	51,6			
28.04.2024	20:55:00	22,3	51,6			
28.04.2024	21:00:00	22,3	51,6	23,1	64,0	7,9
28.04.2024	21:05:00	22,3	51,6			
28.04.2024	21:10:00	22,3	51,6			
28.04.2024	21:15:00	22,2	51,6	23,0	64,1	0,9
28.04.2024	21:20:00	22,3	51,7			
28.04.2024	21:25:00	22,2	51,6			
28.04.2024	21:30:00	22,1	51,7	23,0	64,3	0,0
28.04.2024	21:35:00	22,2	51,7			
28.04.2024	21:40:00	22,2	51,7			
28.04.2024	21:45:00	22,1	51,7	23,0	64,4	0,0
28.04.2024	21:50:00	22,2	51,7			
28.04.2024	21:55:00	22,2	51,7			
28.04.2024	22:00:00	22,2	51,7	22,9	64,5	0,0
28.04.2024	22:05:00	22,2	51,8			
28.04.2024	22:10:00	22,2	51,8			
28.04.2024	22:15:00	22,2	51,8	22,9	64,6	0,2
28.04.2024	22:20:00	22,2	51,8			
28.04.2024	22:25:00	22,2	51,8			
28.04.2024	22:30:00	22,2	51,8	22,8	64,7	0,0
28.04.2024	22:35:00	22,2	51,8			
28.04.2024	22:40:00	22,2	51,8			
28.04.2024	22:45:00	22,2	51,9	22,8	64,8	0,0
28.04.2024	22:50:00	22,2	51,9			
28.04.2024	22:55:00	22,2	51,8			
28.04.2024	23:00:00	22,2	51,9	22,7	64,9	0,2
28.04.2024	23:05:00	22,2	51,8			
28.04.2024	23:10:00	22,0	51,8			
28.04.2024	23:15:00	22,2	52,0	22,7	65,0	0,1
28.04.2024	23:20:00	22,2	51,8			
28.04.2024	23:25:00	22,2	51,9			
28.04.2024	23:30:00	22,2	51,9	22,7	65,0	0,1
28.04.2024	23:35:00	22,1	51,9			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
28.04.2024	23:40:00	22,1	51,9			
28.04.2024	23:45:00	22,1	51,9	22,6	65,0	0,1
28.04.2024	23:50:00	22,1	51,9			
28.04.2024	23:55:00	22,0	52,0			
29.04.2024	00:00:00	22,1	52,0	22,6	65,2	0,1
29.04.2024	00:05:00	22,1	52,0			
29.04.2024	00:10:00	22,0	52,0			
29.04.2024	00:15:00	22,1	51,9	22,6	65,2	0,0
29.04.2024	00:20:00	22,1	52,0			
29.04.2024	00:25:00	22,1	52,0			
29.04.2024	00:30:00	22,2	52,0	22,6	65,3	0,0
29.04.2024	00:35:00	22,2	51,9			
29.04.2024	00:40:00	22,2	52,0			
29.04.2024	00:45:00	22,0	52,0	22,6	65,2	0,0
29.04.2024	00:50:00	22,2	51,9			
29.04.2024	00:55:00	22,2	52,0			
29.04.2024	01:00:00	22,2	52,0	22,6	65,3	0,0
29.04.2024	01:05:00	22,2	52,0			
29.04.2024	01:10:00	22,2	52,0			
29.04.2024	01:15:00	22,2	51,9	22,7	65,1	0,0
29.04.2024	01:20:00	22,2	52,0			
29.04.2024	01:25:00	22,2	52,0			
29.04.2024	01:30:00	22,2	51,9	22,8	65,1	0,0
29.04.2024	01:35:00	22,2	51,9			
29.04.2024	01:40:00	22,2	51,9			
29.04.2024	01:45:00	22,3	52,0	22,8	64,9	0,0
29.04.2024	01:50:00	22,3	51,9			
29.04.2024	01:55:00	22,3	51,9			
29.04.2024	02:00:00	22,3	51,9	22,9	64,8	0,1
29.04.2024	02:05:00	22,3	51,8			
29.04.2024	02:10:00	22,3	51,8			
29.04.2024	02:15:00	22,3	51,8	22,9	64,7	0,2
29.04.2024	02:20:00	22,3	51,8			
29.04.2024	02:25:00	22,3	51,8			
29.04.2024	02:30:00	22,3	51,8	22,9	64,5	0,0
29.04.2024	02:35:00	22,3	51,8			
29.04.2024	02:40:00	22,3	51,8			
29.04.2024	02:45:00	22,3	51,7	23,0	64,4	0,0
29.04.2024	02:50:00	22,3	51,7			
29.04.2024	02:55:00	22,3	51,7			
29.04.2024	03:00:00	22,3	51,7	23,0	64,3	0,0
29.04.2024	03:05:00	22,3	51,7			
29.04.2024	03:10:00	22,3	51,6			
29.04.2024	03:15:00	22,3	51,6	23,0	64,3	0,1
29.04.2024	03:20:00	22,3	51,6			
29.04.2024	03:25:00	22,3	51,6			
29.04.2024	03:30:00	22,3	51,6	23,0	64,3	0,1
29.04.2024	03:35:00	22,3	51,6			
29.04.2024	03:40:00	22,3	51,6			
29.04.2024	03:45:00	22,3	51,5	23,0	64,2	0,1



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
29.04.2024	03:50:00	22,3	51,5			
29.04.2024	03:55:00	22,3	51,5			
29.04.2024	04:00:00	22,1	51,4	23,0	64,1	0,0
29.04.2024	04:05:00	22,3	51,5			
29.04.2024	04:10:00	22,3	51,4			
29.04.2024	04:15:00	22,3	51,4	23,0	64,1	0,2
29.04.2024	04:20:00	22,3	51,4			
29.04.2024	04:25:00	22,3	51,4			
29.04.2024	04:30:00	22,3	51,4	22,9	64,0	0,1
29.04.2024	04:35:00	22,3	51,3			
29.04.2024	04:40:00	22,1	51,3			
29.04.2024	04:45:00	22,3	51,3	22,9	64,0	0,0
29.04.2024	04:50:00	22,1	51,3			
29.04.2024	04:55:00	22,3	51,3			
29.04.2024	05:00:00	22,3	51,2	22,9	64,0	0,0
29.04.2024	05:05:00	22,3	51,3			
29.04.2024	05:10:00	22,3	51,2			
29.04.2024	05:15:00	22,2	51,2	22,8	63,9	1,0
29.04.2024	05:20:00	22,3	51,2			
29.04.2024	05:25:00	22,3	51,1			
29.04.2024	05:30:00	22,2	51,1	22,8	63,9	11,6
29.04.2024	05:35:00	22,2	51,2			
29.04.2024	05:40:00	22,1	51,1			
29.04.2024	05:45:00	22,2	51,1	22,8	63,8	69,5
29.04.2024	05:50:00	22,2	51,0			
29.04.2024	05:55:00	22,2	51,1			
29.04.2024	06:00:00	22,2	51,0	22,8	63,8	253,9
29.04.2024	06:05:00	22,2	51,0			
29.04.2024	06:10:00	22,2	51,0			
29.04.2024	06:15:00	22,2	51,0	22,7	63,7	641,5
29.04.2024	06:20:00	22,2	51,0			
29.04.2024	06:25:00	22,0	51,0			
29.04.2024	06:30:00	22,2	50,9	22,8	63,5	1218,6
29.04.2024	06:35:00	22,2	50,9			
29.04.2024	06:40:00	22,2	50,9			
29.04.2024	06:45:00	22,2	50,9	22,9	63,2	1858,0
29.04.2024	06:50:00	22,2	50,8			
29.04.2024	06:55:00	22,2	50,8			
29.04.2024	07:00:00	22,1	48,4	22,7	58,6	2266,3
29.04.2024	07:05:00	21,8	45,3			
29.04.2024	07:10:00	21,6	45,9			
29.04.2024	07:15:00	21,6	44,7	22,3	56,8	2652,0
29.04.2024	07:20:00	21,5	43,6			
29.04.2024	07:25:00	21,1	43,9			
29.04.2024	07:30:00	21,1	42,8	22,0	56,7	2904,0
29.04.2024	07:35:00	21,1	43,8			
29.04.2024	07:40:00	20,8	44,5			
29.04.2024	07:45:00	20,9	43,2	21,8	56,9	3021,9
29.04.2024	07:50:00	20,7	43,4			
29.04.2024	07:55:00	20,8	45,6			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
29.04.2024	08:00:00	20,9	44,1	21,6	56,7	3236,5
29.04.2024	08:05:00	21,0	43,3			
29.04.2024	08:10:00	20,9	43,9			
29.04.2024	08:15:00	20,9	44,1	21,5	57,1	3388,0
29.04.2024	08:20:00	20,6	44,9			
29.04.2024	08:25:00	20,7	44,9			
29.04.2024	08:30:00	20,9	44,1	21,4	56,9	4069,2
29.04.2024	08:35:00	20,7	42,2			
29.04.2024	08:40:00	20,5	42,9			
29.04.2024	08:45:00	20,5	44,8	21,5	57,0	3864,6
29.04.2024	08:50:00	20,3	43,4			
29.04.2024	08:55:00	20,4	43,9			
29.04.2024	09:00:00	20,3	43,6	21,5	56,9	4491,3
29.04.2024	09:05:00	20,3	43,8			
29.04.2024	09:10:00	20,3	43,6			
29.04.2024	09:15:00	20,0	44,2	21,7	57,0	4956,4
29.04.2024	09:20:00	19,9	44,9			
29.04.2024	09:25:00	20,0	45,0			
29.04.2024	09:30:00	20,1	44,2	21,8	56,4	5290,8
29.04.2024	09:35:00	20,0	44,2			
29.04.2024	09:40:00	19,9	44,4			
29.04.2024	09:45:00	19,6	45,1	21,9	56,4	4524,7
29.04.2024	09:50:00	19,7	###			
29.04.2024	09:55:00	19,7	45,5			
29.04.2024	10:00:00	19,8	45,6	22,1	56,4	5443,3
29.04.2024	10:05:00	19,8	46,3			
29.04.2024	10:10:00	20,2	46,9			
29.04.2024	10:15:00	20,5	46,7	22,2	55,7	6180,4
29.04.2024	10:20:00	20,8	###			
29.04.2024	10:25:00	21,0	46,4			
29.04.2024	10:30:00	21,2	46,2	22,4	55,7	6855,3
29.04.2024	10:35:00	21,3	45,8			
29.04.2024	10:40:00	21,3	45,7			
29.04.2024	10:45:00	21,4	46,0	22,7	55,8	6234,4
29.04.2024	10:50:00	21,5	46,1			
29.04.2024	10:55:00	21,6	45,3			
29.04.2024	11:00:00	21,6	44,9	23,0	55,4	9193,5
29.04.2024	11:05:00	21,6	44,4			
29.04.2024	11:10:00	21,6	44,3			
29.04.2024	11:15:00	21,6	43,8	23,3	53,9	5310,6
29.04.2024	11:20:00	21,6	43,8			
29.04.2024	11:25:00	21,7	43,6			
29.04.2024	11:30:00	21,5	43,1	23,5	53,6	7711,2
29.04.2024	11:35:00	21,7	43,1			
29.04.2024	11:40:00	21,8	42,9			
29.04.2024	11:45:00	21,8	42,5	23,8	53,6	8599,2
29.04.2024	11:50:00	21,8	42,6			
29.04.2024	11:55:00	21,9	42,1			
29.04.2024	12:00:00	21,9	42,1	24,1	52,3	7903,4
29.04.2024	12:05:00	22,0	41,8			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
29.04.2024	12:10:00	22,0	41,4			
29.04.2024	12:15:00	21,9	41,4	24,4	52,6	7635,8
29.04.2024	12:20:00	22,1	41,2			
29.04.2024	12:25:00	22,1	41,3			
29.04.2024	12:30:00	22,1	41,4	24,6	50,8	9192,1
29.04.2024	12:35:00	22,1	41,2			
29.04.2024	12:40:00	22,1	40,8			
29.04.2024	12:45:00	22,1	41,0	24,9	51,4	7018,5
29.04.2024	12:50:00	22,2	41,0			
29.04.2024	12:55:00	22,2	40,9			
29.04.2024	13:00:00	22,2	40,9	24,9	50,8	7415,0
29.04.2024	13:05:00	22,2	40,9			
29.04.2024	13:10:00	22,3	40,9			
29.04.2024	13:15:00	22,1	40,9	25,1	50,6	6829,5
29.04.2024	13:20:00	22,3	41,0			
29.04.2024	13:25:00	22,3	41,0			
29.04.2024	13:30:00	22,3	40,9	25,1	51,1	8705,5
29.04.2024	13:35:00	22,4	40,9			
29.04.2024	13:40:00	22,4	41,0			
29.04.2024	13:45:00	22,3	40,7	25,3	51,3	7935,1
29.04.2024	13:50:00	22,5	40,8			
29.04.2024	13:55:00	22,6	41,1			
29.04.2024	14:00:00	22,6	41,3	25,5	52,0	8276,6
29.04.2024	14:05:00	22,7	41,5			
29.04.2024	14:10:00	22,7	41,7			
29.04.2024	14:15:00	22,7	41,9	25,5	52,6	8477,7
29.04.2024	14:20:00	22,8	42,0			
29.04.2024	14:25:00	22,8	42,1			
29.04.2024	14:30:00	22,9	42,2	25,7	52,8	7214,4
29.04.2024	14:35:00	22,9	42,2			
29.04.2024	14:40:00	23,0	42,3			
29.04.2024	14:45:00	23,1	42,3	25,9	53,3	8403,0
29.04.2024	14:50:00	23,1	42,3			
29.04.2024	14:55:00	23,1	42,4			
29.04.2024	15:00:00	23,2	42,4	26,2	52,8	8717,9
29.04.2024	15:05:00	23,2	42,5			
29.04.2024	15:10:00	23,1	42,5			
29.04.2024	15:15:00	23,3	42,5	26,2	51,1	6711,6
29.04.2024	15:20:00	23,3	42,5			
29.04.2024	15:25:00	23,3	42,5			
29.04.2024	15:30:00	23,4	42,4	26,2	51,2	6114,7
29.04.2024	15:35:00	23,4	42,5			
29.04.2024	15:40:00	23,4	42,3			
29.04.2024	15:45:00	23,4	42,3	26,3	50,3	6588,0
29.04.2024	15:50:00	23,4	42,3			
29.04.2024	15:55:00	23,4	42,3			
29.04.2024	16:00:00	23,4	42,4	26,1	51,3	6282,2
29.04.2024	16:05:00	23,5	42,6			
29.04.2024	16:10:00	23,5	42,7			
29.04.2024	16:15:00	23,6	42,6	26,2	51,3	5317,2



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
29.04.2024	16:20:00	23,6	42,6			
29.04.2024	16:25:00	23,6	42,7			
29.04.2024	16:30:00	23,7	42,6	26,3	50,7	6597,8
29.04.2024	16:35:00	23,7	42,7			
29.04.2024	16:40:00	23,8	42,7			
29.04.2024	16:45:00	23,8	42,6	26,3	51,4	6540,5
29.04.2024	16:50:00	23,8	42,7			
29.04.2024	16:55:00	23,8	42,6			
29.04.2024	17:00:00	23,8	42,5	26,3	56,6	4954,7
29.04.2024	17:05:00	23,8	42,5			
29.04.2024	17:10:00	23,7	42,5			
29.04.2024	17:15:00	23,6	42,5	26,1	58,0	5655,7
29.04.2024	17:20:00	23,8	42,5			
29.04.2024	17:25:00	23,8	42,5			
29.04.2024	17:30:00	23,8	42,5	26,1	62,6	5088,8
29.04.2024	17:35:00	23,8	42,4			
29.04.2024	17:40:00	23,8	42,4			
29.04.2024	17:45:00	23,8	42,5	26,3	62,4	5709,4
29.04.2024	17:50:00	23,8	42,4			
29.04.2024	17:55:00	23,8	42,3			
29.04.2024	18:00:00	23,8	42,4	26,6	62,4	6995,6
29.04.2024	18:05:00	23,9	42,3			
29.04.2024	18:10:00	23,9	42,3			
29.04.2024	18:15:00	23,8	42,3	27,8	60,7	7030,4
29.04.2024	18:20:00	23,8	42,3			
29.04.2024	18:25:00	24,0	42,3			
29.04.2024	18:30:00	23,9	42,2	27,0	58,1	5140,6
29.04.2024	18:35:00	24,0	42,3			
29.04.2024	18:40:00	24,0	42,2			
29.04.2024	18:45:00	23,9	42,0	26,6	60,2	3899,2
29.04.2024	18:50:00	23,9	42,1			
29.04.2024	18:55:00	23,8	42,1			
29.04.2024	19:00:00	23,9	42,1	26,2	60,2	3867,3
29.04.2024	19:05:00	23,8	42,2			
29.04.2024	19:10:00	23,8	42,2			
29.04.2024	19:15:00	23,8	42,1	25,9	58,3	3108,3
29.04.2024	19:20:00	23,6	42,1			
29.04.2024	19:25:00	23,7	42,1			
29.04.2024	19:30:00	23,6	42,1	25,5	62,8	2096,0
29.04.2024	19:35:00	23,7	42,1			
29.04.2024	19:40:00	23,7	42,1			
29.04.2024	19:45:00	23,7	42,1	25,3	62,9	1569,5
29.04.2024	19:50:00	23,6	42,1			
29.04.2024	19:55:00	23,6	42,1			
29.04.2024	20:00:00	23,6	42,1	25,0	57,9	1855,6
29.04.2024	20:05:00	23,6	42,1			
29.04.2024	20:10:00	23,6	42,1			
29.04.2024	20:15:00	23,6	42,0	24,8	55,7	995,7
29.04.2024	20:20:00	23,6	42,1			
29.04.2024	20:25:00	23,5	42,1			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
29.04.2024	20:30:00	23,4	42,1	24,6	55,3	296,9
29.04.2024	20:35:00	23,4	42,1			
29.04.2024	20:40:00	23,4	42,1			
29.04.2024	20:45:00	23,5	42,1	24,4	55,4	102,3
29.04.2024	20:50:00	23,5	42,2			
29.04.2024	20:55:00	23,5	42,2			
29.04.2024	21:00:00	23,5	42,2	24,2	55,4	15,4
29.04.2024	21:05:00	23,5	42,2			
29.04.2024	21:10:00	23,3	42,2			
29.04.2024	21:15:00	23,4	42,2	24,1	55,9	2,7
29.04.2024	21:20:00	23,4	42,3			
29.04.2024	21:25:00	23,4	42,4			
29.04.2024	21:30:00	23,4	42,4	24,0	56,2	0,3
29.04.2024	21:35:00	23,4	42,4			
29.04.2024	21:40:00	23,4	42,4			
29.04.2024	21:45:00	23,4	42,4	23,9	56,4	0,1
29.04.2024	21:50:00	23,4	42,4			
29.04.2024	21:55:00	23,4	42,4			
29.04.2024	22:00:00	23,4	42,5	23,8	56,7	0,2
29.04.2024	22:05:00	23,4	42,5			
29.04.2024	22:10:00	23,3	42,5			
29.04.2024	22:15:00	23,3	42,5	23,8	56,9	0,1
29.04.2024	22:20:00	23,3	42,6			
29.04.2024	22:25:00	23,3	42,6			
29.04.2024	22:30:00	23,3	42,6	23,7	57,2	0,2
29.04.2024	22:35:00	23,3	42,7			
29.04.2024	22:40:00	23,3	42,7			
29.04.2024	22:45:00	23,3	42,7	23,7	57,4	0,1
29.04.2024	22:50:00	23,3	42,8			
29.04.2024	22:55:00	23,3	42,8			
29.04.2024	23:00:00	23,3	42,8	23,6	57,5	0,1
29.04.2024	23:05:00	23,3	42,8			
29.04.2024	23:10:00	23,3	42,9			
29.04.2024	23:15:00	23,1	42,9	23,5	57,6	0,0
29.04.2024	23:20:00	23,3	42,9			
29.04.2024	23:25:00	23,2	43,0			
29.04.2024	23:30:00	23,1	42,9	23,5	57,7	0,0
29.04.2024	23:35:00	23,2	43,0			
29.04.2024	23:40:00	23,2	43,0			
29.04.2024	23:45:00	23,2	43,0	23,5	58,0	0,0
29.04.2024	23:50:00	23,2	43,1			
29.04.2024	23:55:00	23,2	43,1			
30.04.2024	00:00:00	23,2	43,1	23,4	58,0	0,0
30.04.2024	00:05:00	23,2	43,1			
30.04.2024	00:10:00	23,2	43,2			
30.04.2024	00:15:00	23,2	43,2	23,4	58,1	0,0
30.04.2024	00:20:00	23,2	43,2			
30.04.2024	00:25:00	23,2	43,1			
30.04.2024	00:30:00	23,2	43,2	23,3	58,0	0,0
30.04.2024	00:35:00	23,0	43,2			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
30.04.2024	00:40:00	23,2	43,2			
30.04.2024	00:45:00	23,2	43,2	23,3	58,1	0,2
30.04.2024	00:50:00	23,2	43,2			
30.04.2024	00:55:00	23,1	43,2			
30.04.2024	01:00:00	23,0	43,3	23,3	58,2	0,0
30.04.2024	01:05:00	23,1	43,3			
30.04.2024	01:10:00	23,1	43,3			
30.04.2024	01:15:00	23,1	43,3	23,2	58,4	0,0
30.04.2024	01:20:00	23,1	43,4			
30.04.2024	01:25:00	23,1	43,4			
30.04.2024	01:30:00	23,1	43,4	23,2	58,5	0,1
30.04.2024	01:35:00	23,1	43,4			
30.04.2024	01:40:00	23,1	43,5			
30.04.2024	01:45:00	23,1	43,4	23,2	58,5	0,0
30.04.2024	01:50:00	23,1	43,4			
30.04.2024	01:55:00	23,1	43,5			
30.04.2024	02:00:00	23,1	43,5	23,2	58,6	0,0
30.04.2024	02:05:00	23,1	43,4			
30.04.2024	02:10:00	23,1	43,5			
30.04.2024	02:15:00	23,1	43,5	23,2	58,5	0,0
30.04.2024	02:20:00	23,1	43,5			
30.04.2024	02:25:00	23,1	43,5			
30.04.2024	02:30:00	23,1	43,5	23,1	58,4	0,0
30.04.2024	02:35:00	23,1	43,4			
30.04.2024	02:40:00	23,1	43,4			
30.04.2024	02:45:00	23,1	43,4	23,1	58,2	0,0
30.04.2024	02:50:00	23,0	43,4			
30.04.2024	02:55:00	23,0	43,3			
30.04.2024	03:00:00	23,0	43,2	23,1	58,3	0,0
30.04.2024	03:05:00	23,0	43,3			
30.04.2024	03:10:00	23,0	43,3			
30.04.2024	03:15:00	23,0	43,2	23,0	58,3	0,1
30.04.2024	03:20:00	23,0	43,2			
30.04.2024	03:25:00	22,9	43,2			
30.04.2024	03:30:00	23,0	43,2	23,0	58,2	0,1
30.04.2024	03:35:00	23,0	43,2			
30.04.2024	03:40:00	23,0	43,2			
30.04.2024	03:45:00	23,0	43,1	23,0	58,2	0,0
30.04.2024	03:50:00	23,0	43,1			
30.04.2024	03:55:00	23,0	43,1			
30.04.2024	04:00:00	23,0	43,1	22,9	58,2	0,2
30.04.2024	04:05:00	22,9	43,1			
30.04.2024	04:10:00	22,9	43,1			
30.04.2024	04:15:00	22,9	43,1	22,9	58,4	0,0
30.04.2024	04:20:00	22,9	43,1			
30.04.2024	04:25:00	22,9	43,1			
30.04.2024	04:30:00	22,9	43,1	22,8	58,5	0,1
30.04.2024	04:35:00	22,9	43,2			
30.04.2024	04:40:00	22,9	43,2			
30.04.2024	04:45:00	22,9	43,2	22,9	58,4	0,0



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
30.04.2024	04:50:00	22,7	43,2			
30.04.2024	04:55:00	22,7	43,2			
30.04.2024	05:00:00	22,9	43,2	22,8	58,5	0,0
30.04.2024	05:05:00	22,9	43,2			
30.04.2024	05:10:00	22,8	43,2			
30.04.2024	05:15:00	22,8	43,2	22,7	58,6	0,9
30.04.2024	05:20:00	22,8	43,2			
30.04.2024	05:25:00	22,8	43,2			
30.04.2024	05:30:00	22,8	43,2	22,7	58,6	9,9
30.04.2024	05:35:00	22,8	43,1			
30.04.2024	05:40:00	22,8	43,1			
30.04.2024	05:45:00	22,8	43,1	22,7	58,6	55,3
30.04.2024	05:50:00	22,8	43,1			
30.04.2024	05:55:00	22,6	43,1			
30.04.2024	06:00:00	22,8	43,1	22,6	58,5	191,6
30.04.2024	06:05:00	22,7	43,1			
30.04.2024	06:10:00	22,8	43,0			
30.04.2024	06:15:00	22,7	43,0	22,6	58,5	423,1
30.04.2024	06:20:00	22,6	43,0			
30.04.2024	06:25:00	22,6	43,0			
30.04.2024	06:30:00	22,7	43,2	22,6	58,3	848,8
30.04.2024	06:35:00	22,6	44,2			
30.04.2024	06:40:00	22,6	44,9			
30.04.2024	06:45:00	22,8	45,0	22,6	58,2	1226,7
30.04.2024	06:50:00	22,7	45,0			
30.04.2024	06:55:00	22,9	45,0			
30.04.2024	07:00:00	22,9	44,9	22,7	58,1	1744,4
30.04.2024	07:05:00	22,8	44,9			
30.04.2024	07:10:00	23,0	45,6			
30.04.2024	07:15:00	22,9	45,4	22,8	59,6	2445,5
30.04.2024	07:20:00	23,0	44,3			
30.04.2024	07:25:00	23,0	43,6			
30.04.2024	07:30:00	23,0	43,0	22,8	57,6	3188,7
30.04.2024	07:35:00	23,0	42,7			
30.04.2024	07:40:00	22,9	42,6			
30.04.2024	07:45:00	23,0	42,2	22,7	56,8	3703,5
30.04.2024	07:50:00	23,0	42,1			
30.04.2024	07:55:00	22,9	42,0			
30.04.2024	08:00:00	23,0	41,7	22,8	55,8	4368,4
30.04.2024	08:05:00	22,9	41,4			
30.04.2024	08:10:00	22,9	41,3			
30.04.2024	08:15:00	22,9	41,2	22,9	55,6	3770,8
30.04.2024	08:20:00	22,9	41,0			
30.04.2024	08:25:00	22,9	41,2			
30.04.2024	08:30:00	22,9	41,0	22,9	55,6	3809,5
30.04.2024	08:35:00	22,9	40,9			
30.04.2024	08:40:00	22,9	41,0			
30.04.2024	08:45:00	22,9	40,8	22,9	56,1	4047,3
30.04.2024	08:50:00	22,9	40,8			
30.04.2024	08:55:00	23,0	41,3			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort			Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [lx]
30.04.2024	09:00:00		23,0	42,4	22,8	55,9	4619,1
30.04.2024	09:05:00		23,1	41,4			
30.04.2024	09:10:00		23,1	41,2			
30.04.2024	09:15:00		23,0	41,2	22,7	56,6	5467,4
30.04.2024	09:20:00		22,8	40,9			
30.04.2024	09:25:00		23,0	41,0			
30.04.2024	09:30:00		22,9	41,0	22,6	56,0	2958,5
30.04.2024	09:35:00		22,9	41,0			
30.04.2024	09:40:00		22,9	41,1			
30.04.2024	09:45:00		22,8	41,2	22,6	58,0	5454,9
30.04.2024	09:50:00		22,9	41,3			
30.04.2024	09:55:00		23,0	41,8			
30.04.2024	10:00:00		23,0	42,1	22,8	57,4	8033,3
30.04.2024	10:05:00		23,1	42,0			
30.04.2024	10:10:00		23,1	41,9			
30.04.2024	10:15:00		23,1	42,0	22,9	57,2	8210,0
30.04.2024	10:20:00		23,1	41,9			
30.04.2024	10:25:00		23,0	41,9			
30.04.2024	10:30:00		23,1	42,1	22,9	57,2	6989,4
30.04.2024	10:35:00		23,0	42,5			
30.04.2024	10:40:00		23,2	42,3			
30.04.2024	10:45:00		23,2	42,5	23,0	58,3	3959,3
30.04.2024	10:50:00		23,3	42,6			
30.04.2024	10:55:00		23,3	42,5			
30.04.2024	11:00:00		23,3	42,4	23,2	58,3	8768,7
30.04.2024	11:05:00		23,3	42,5			
30.04.2024	11:10:00		23,3	42,6			
30.04.2024	11:15:00		23,3	42,8	23,6	59,7	9427,2
30.04.2024	11:20:00		23,4	43,2			
30.04.2024	11:25:00		23,4	43,2			
30.04.2024	11:30:00		23,4	43,3	23,8	57,8	7919,3
30.04.2024	11:35:00		23,5	43,2			
30.04.2024	11:40:00		23,5	43,3			
30.04.2024	11:45:00		23,5	43,4	23,9	59,3	6833,9
30.04.2024	11:50:00		23,4	43,5			
30.04.2024	11:55:00		23,5	43,5			
30.04.2024	12:00:00		23,6	43,6	24,0	58,4	6762,8
30.04.2024	12:05:00		23,6	43,8			
30.04.2024	12:10:00		23,6	43,5			
30.04.2024	12:15:00		23,6	43,6	24,3	59,4	8437,3
30.04.2024	12:20:00		23,6	43,8			
30.04.2024	12:25:00		23,6	43,7			
30.04.2024	12:30:00		23,7	43,8	24,4	59,1	10532,1
30.04.2024	12:35:00		23,7	43,8			
30.04.2024	12:40:00		23,7	44,0			
30.04.2024	12:45:00		23,7	44,1	24,7	59,4	9743,8
30.04.2024	12:50:00		23,7	44,2			
30.04.2024	12:55:00		23,6	44,3			
30.04.2024	13:00:00		23,7	44,4	24,8	59,4	10159,3
30.04.2024	13:05:00		23,8	44,5			



PDF Export

24.04.2024 16:35:00 - 30.04.2024 16:35:00

Date created 30.04.2024 16:37:16

Created by Account Owner

Ort		Kalibrationslabor [°C]	Kalibrationslabor [%rF]	Langzeitlager [°C]	Langzeitlager [%rF]	Langzeitlager [Ix]
30.04.2024	13:10:00	23,8	44,7			
30.04.2024	13:15:00	23,8	44,8	24,9	59,6	9230,4
30.04.2024	13:20:00	23,8	44,9			
30.04.2024	13:25:00	23,8	44,6			
30.04.2024	13:30:00	23,8	44,6	24,9	60,0	7022,5
30.04.2024	13:35:00	23,8	44,6			
30.04.2024	13:40:00	23,9	44,6			
30.04.2024	13:45:00	23,9	44,6	24,9	60,5	5575,6
30.04.2024	13:50:00	23,8	44,6			
30.04.2024	13:55:00	23,9	44,7			
30.04.2024	14:00:00	24,0	45,5	25,0	60,6	5415,6
30.04.2024	14:05:00	24,1	45,7			
30.04.2024	14:10:00	24,2	45,5			
30.04.2024	14:15:00	24,2	45,8	25,2	61,6	5949,3
30.04.2024	14:20:00	24,3	45,9			
30.04.2024	14:25:00	24,3	46,1			
30.04.2024	14:30:00	24,3	46,2	25,6	59,8	8081,9
30.04.2024	14:35:00	24,3	46,2			
30.04.2024	14:40:00	24,5	46,3			
30.04.2024	14:45:00	24,6	46,5	25,9	58,8	7346,0
30.04.2024	14:50:00	24,7	46,5			
30.04.2024	14:55:00	24,7	46,4			
30.04.2024	15:00:00	24,7	46,3	25,9	59,6	5565,4
30.04.2024	15:05:00	24,8	46,0			
30.04.2024	15:10:00	24,9	45,9			
30.04.2024	15:15:00	25,0	45,6	26,0	58,4	5755,7
30.04.2024	15:20:00	25,0	45,3			
30.04.2024	15:25:00	25,0	44,9			
30.04.2024	15:30:00	25,0	44,9	26,0	58,6	5713,5
30.04.2024	15:35:00	25,0	45,0			
30.04.2024	15:40:00	25,0	45,1			
30.04.2024	15:45:00	25,0	45,1			
30.04.2024	15:50:00	25,0	45,1			
30.04.2024	15:55:00	25,0	45,1			
30.04.2024	16:00:00	25,0	45,2			
30.04.2024	16:05:00	25,0	45,2			
30.04.2024	16:10:00	25,0	45,3			
30.04.2024	16:15:00	25,0	45,3			
30.04.2024	16:20:00	25,0	45,3			
30.04.2024	16:25:00	25,0	45,4			
30.04.2024	16:30:00	25,1	45,3			